

A

B

C

D

E

F

A


B

C

D

E

F

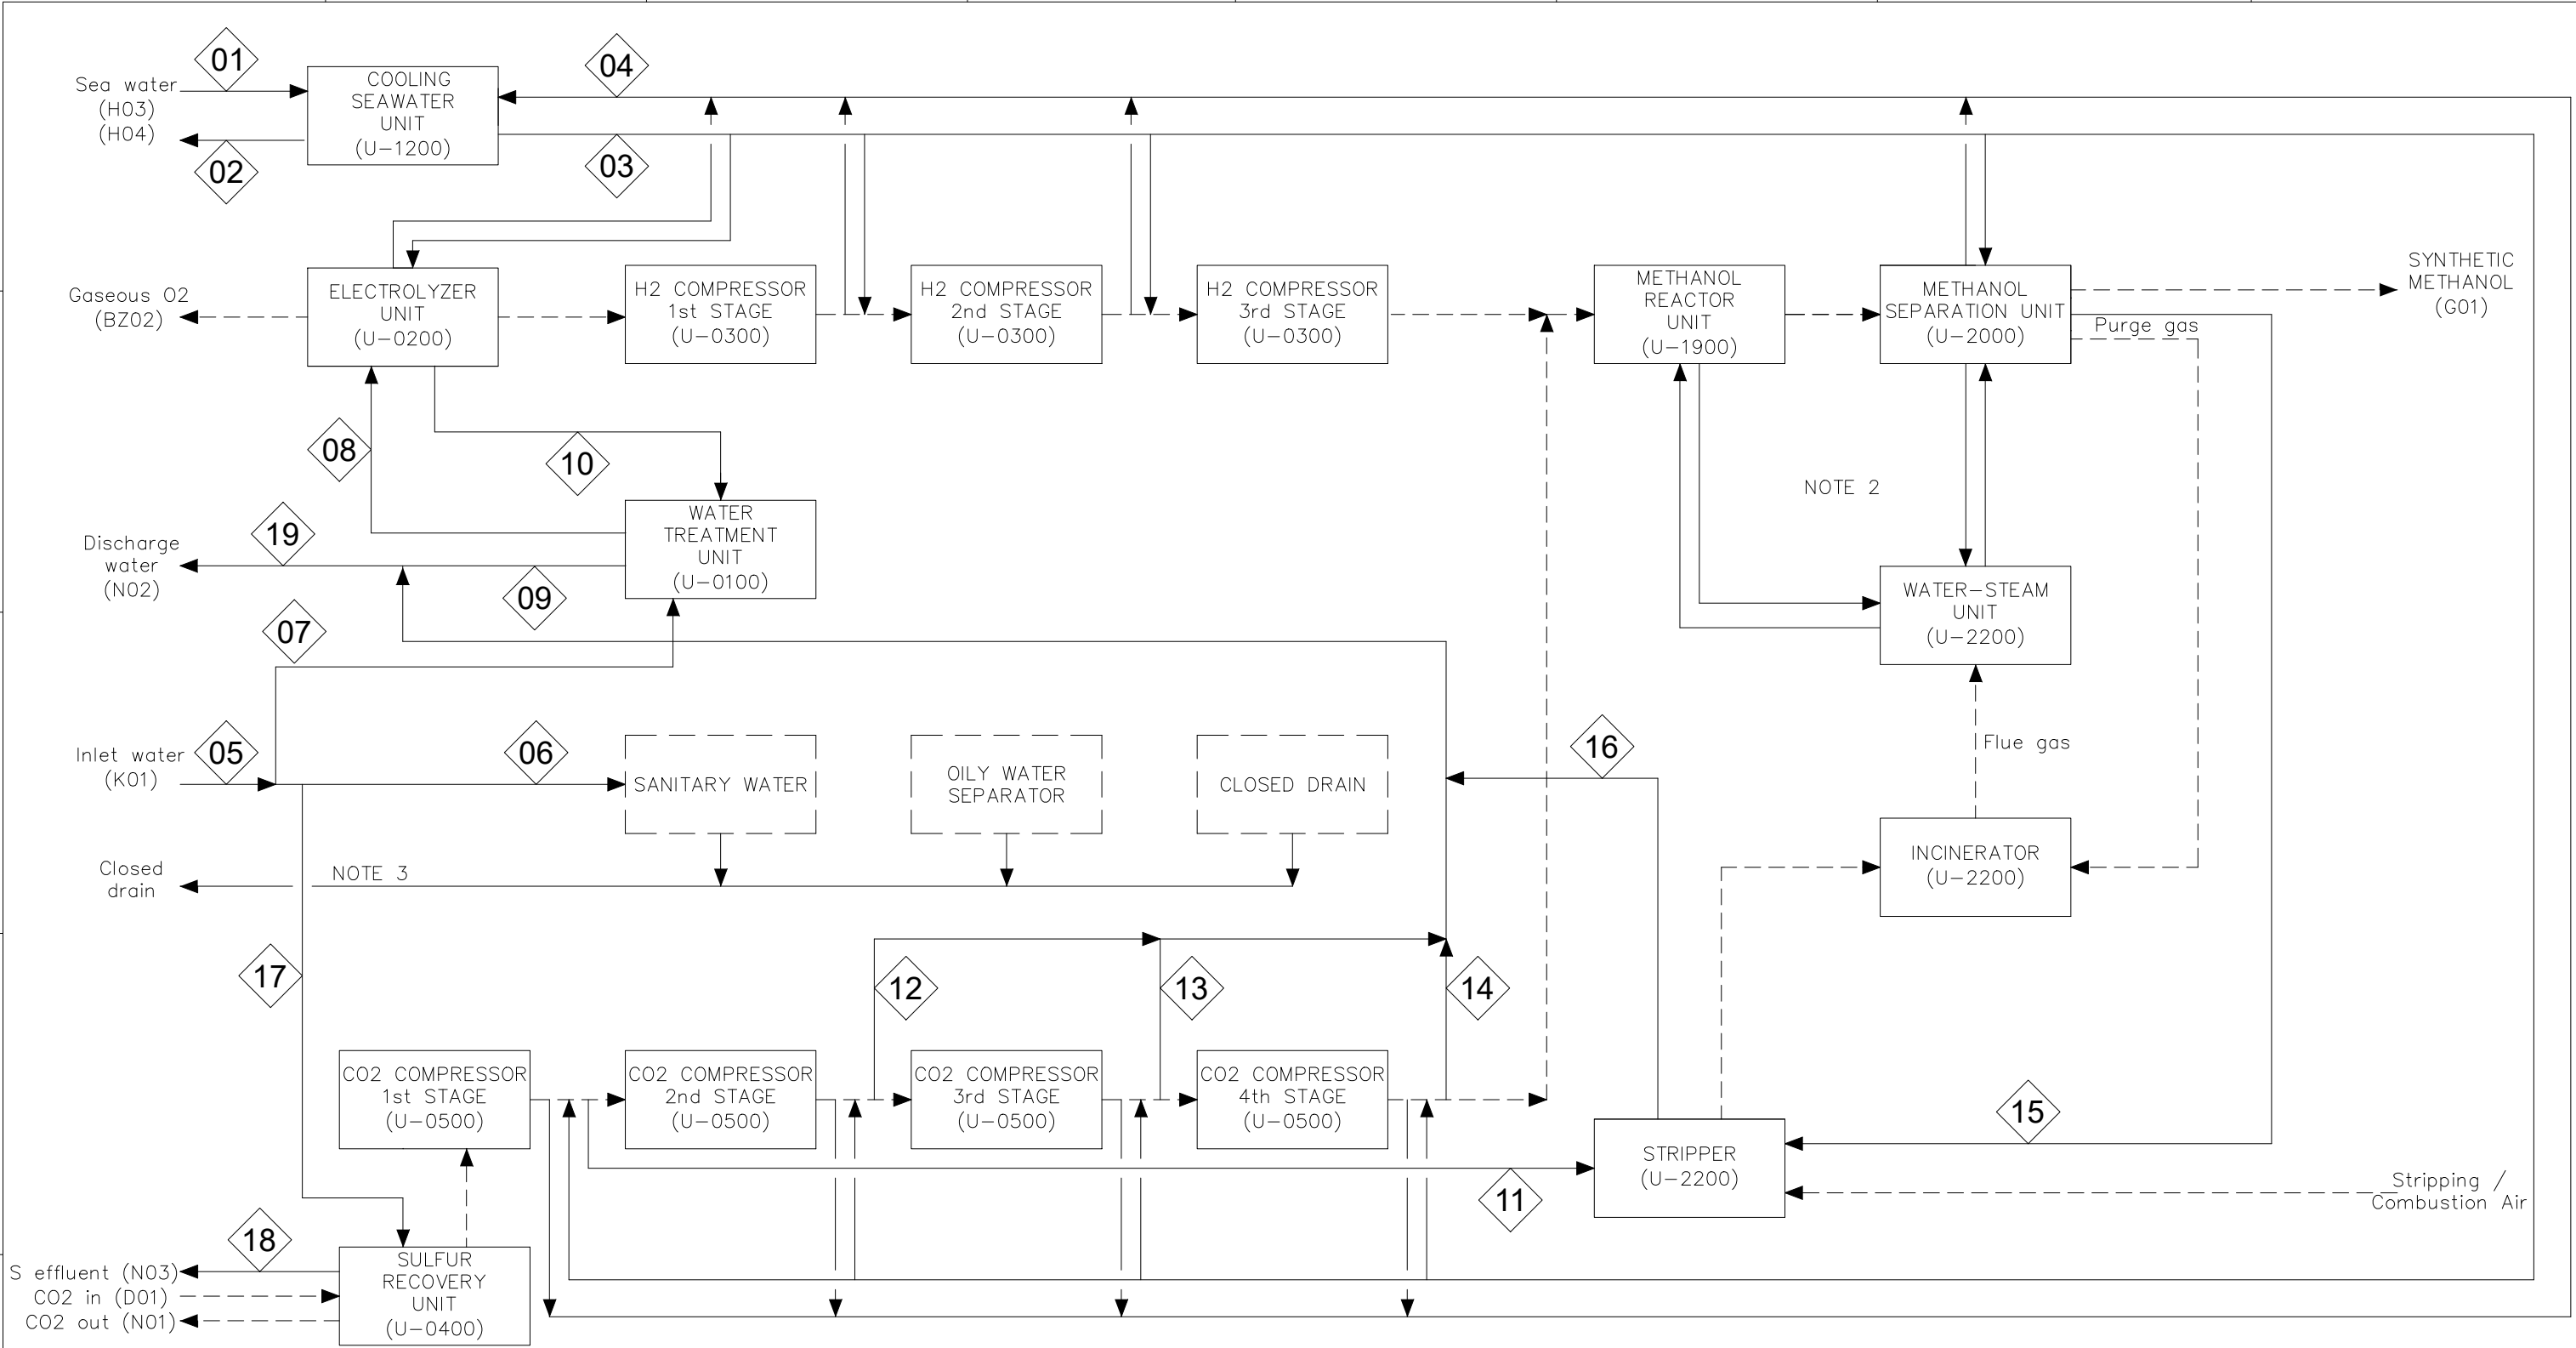

	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19
STREAM	Cooling seawater inlet	Cooling seawater outlet	Cooling water inlet	Cooling water outlet	Inlet water (K01)	Admin building	Water for electrolyzer pre/post treatment		Water treatment discharge	H2 dehydration water	Interstage KO drum	Interstage KO drum	Interstage KO drum	Aftercooler KO drum	Water from Methanol distillation	Stripped water	Sulfur recovery unit water	Sulfur effluent	Total discharge
FLOW [L/s]	230.1		226.9		6.46	350 L/day	1.88	1.39	0.488	0.002	0.007	0.003	0.0002	0.004	0.343	0.350	4.58	4.58	0.848
REMARKS	Sea Water		Cooling Water (closed loop)		Potable Water	Potable Water	Potable Water	Demi Water	High salinity	-	Methanol, CO2, H2S	Methanol, CO2	Methanol, CO2	Methanol, CO2	Methanol	-	Potable Water	Solid S, salts	High salinity

NOTES

- 1.- Water-steam Unit is a closed loop.
2.- Closed drain to be unloaded by truck.



Rev.	Date	Prepared	Checked	Aproved	Description
02B	15-NOV-2024	JMG	JRA	IPB	Issued for Bidding
01	13-NOV-2024	AOE	IOB	IPB	Issued for Bidding
00	28-JUN-2024	AOE	IOB	IPB	Issued for Bidding

Project POWER-TO-MEOH PLANT, REYKJANES II		Document Number 5272-03-DWG-00007		Rev. 02B
Title WASTE WATER BALANCE - NO RECYCLE		Scale S/E	Format A3	Page 1