

A

B

C

D

E

F

A


B

C

D

E

F

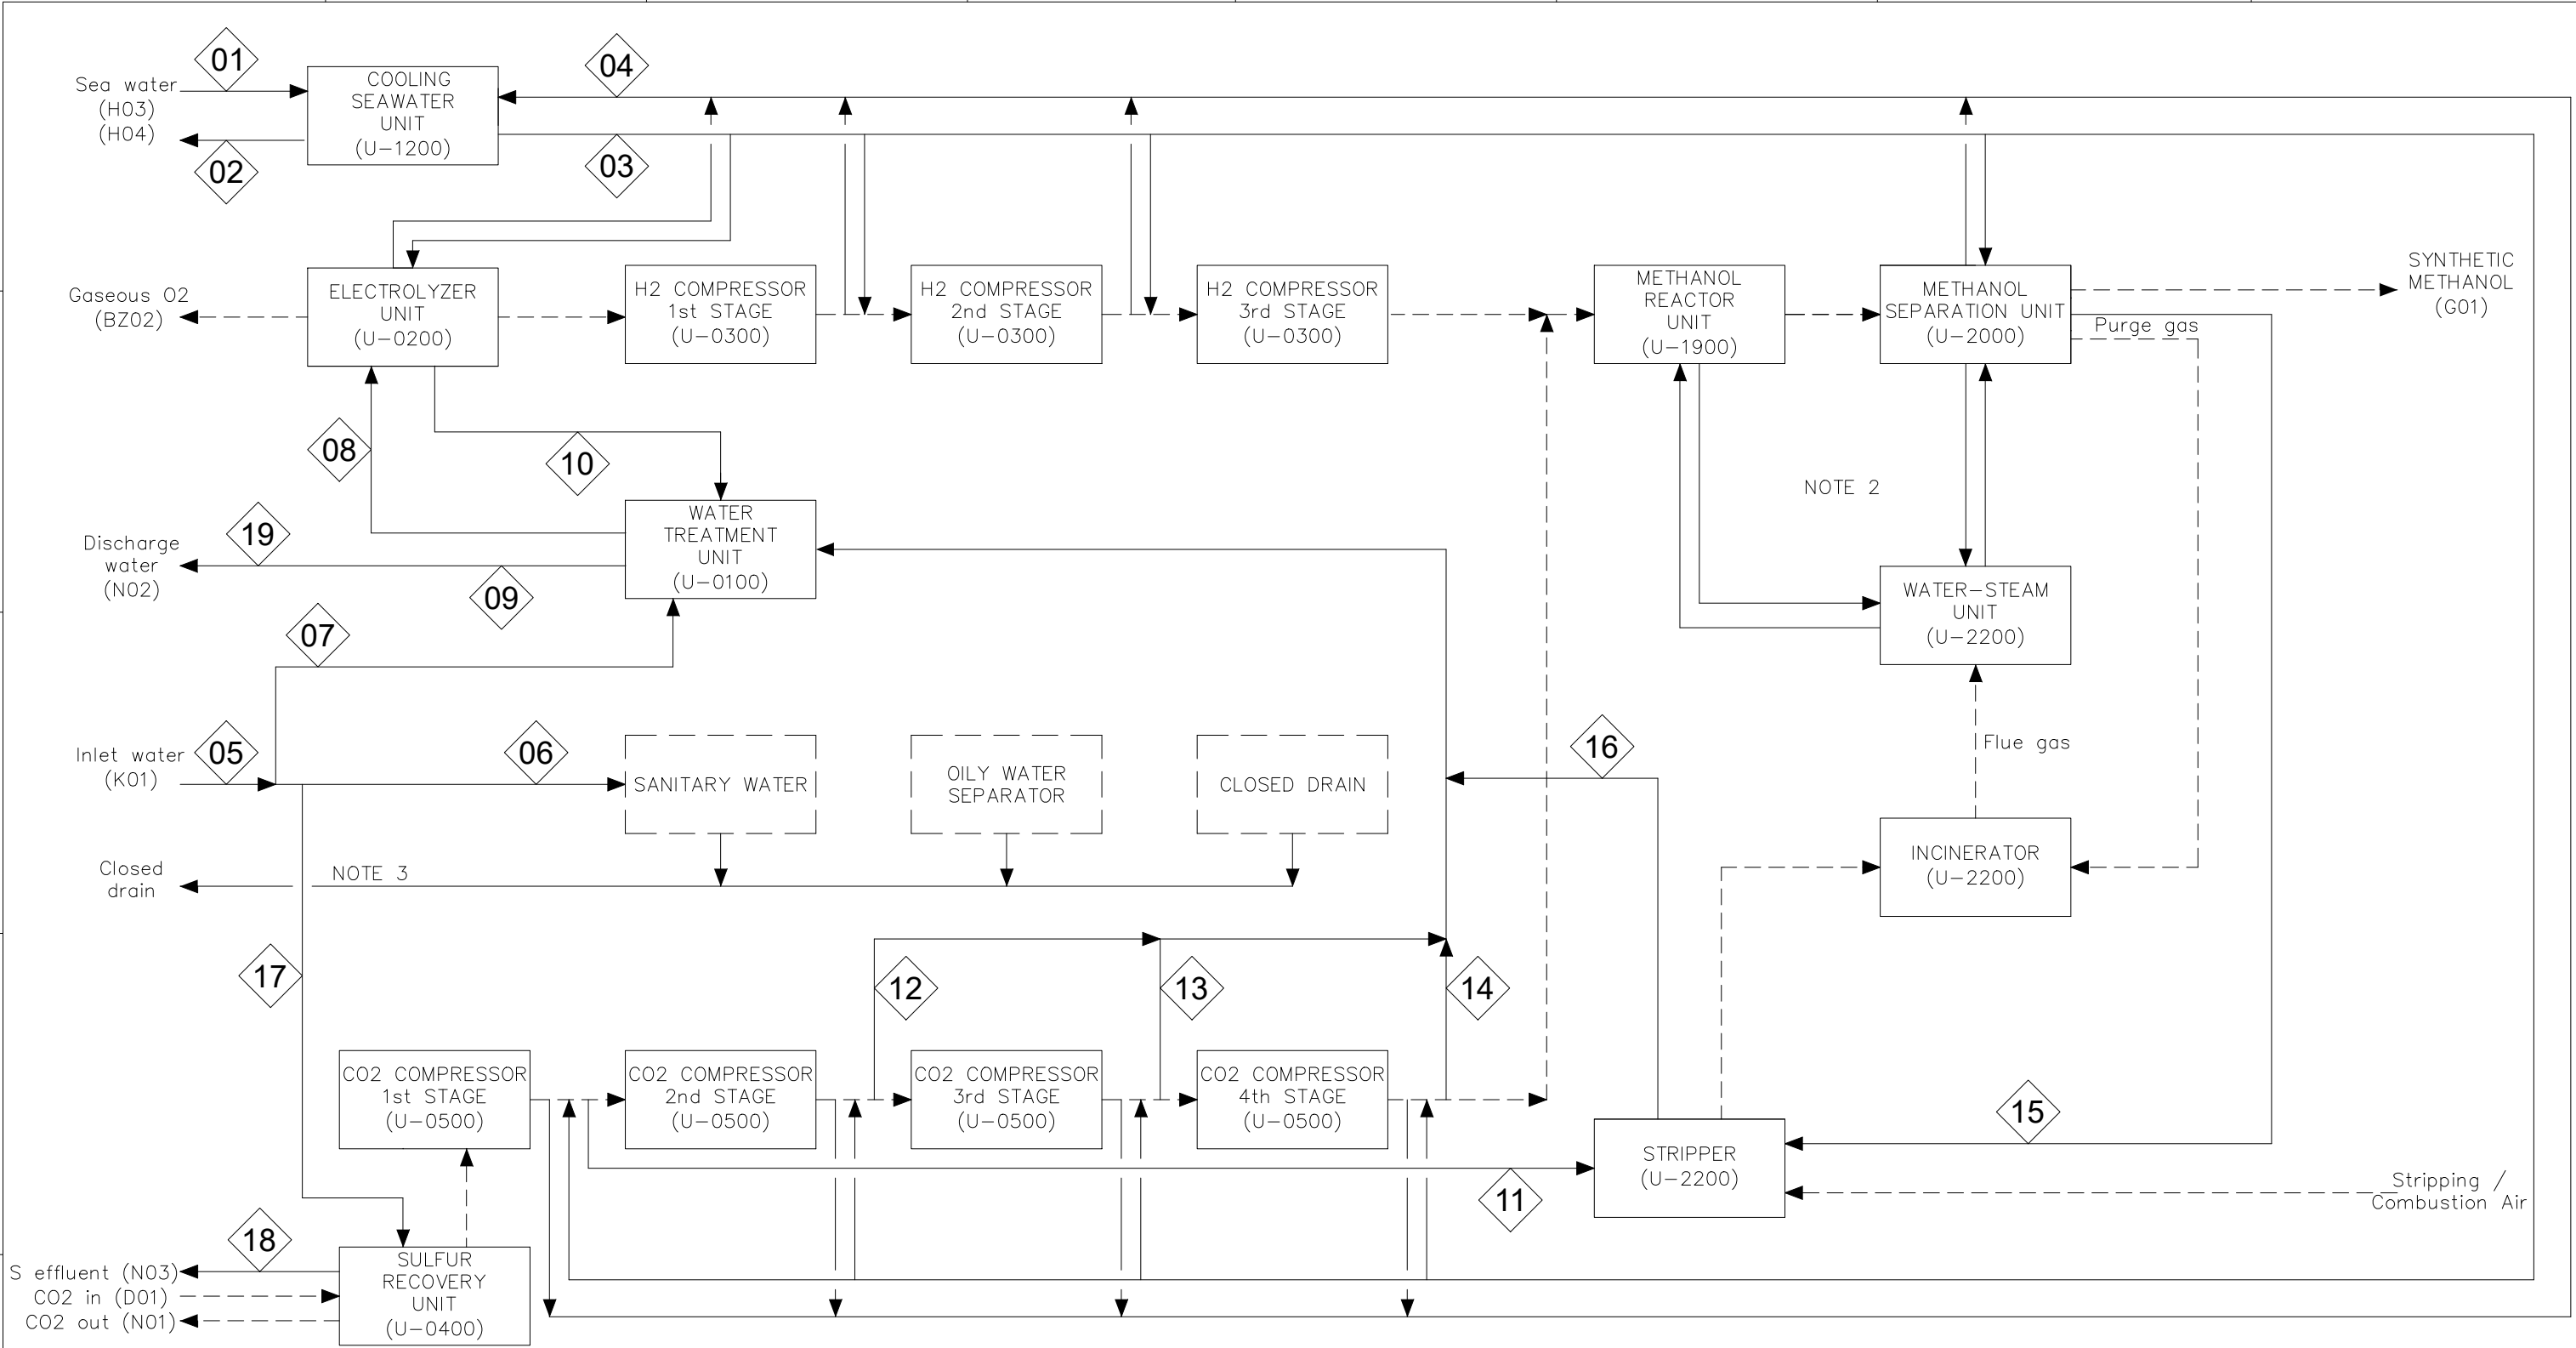

STREAM	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19
FLOW [L/s]	230.1	230.1	226.9	226.9	6.10	350 L/day	1.52	1.39	0.488	0.002	0.007	0.003	0.0002	0.004	0.343	0.350	4.58	4.58	0.488
REMARKS	Sea Water	Sea Water	Cooling Water (closed loop)	Cooling Water (closed loop)	Potable Water	Potable Water	Potable Water	Demi Water	High salinity	-	Methanol, CO2, H2S	Methanol, CO2	Methanol, CO2	Methanol, CO2	Methanol	-	Potable Water	Solid S, salts	High salinity

NOTES

- 1.- Water-steam Unit is a closed loop.
2.- Closed drain to be unloaded by truck.



Rev.	Date	Prepared	Checked	Aproved	Description
02A	15-NOV-2024	JMG	JRA	IPB	Issued for Bidding
01	13-NOV-2024	AOE	IOB	IPB	Issued for Bidding
00	28-JUN-2024	AOE	IOB	IPB	Issued for Bidding

Project	POWER-TO-MEOL PLANT, REYKJANES II	Document Number	5272-03-DWG-00007	Rev.	02A
Title	WASTE WATER BALANCE	Scale	S/E	Format	A3
		ISO - E		Page	1