



Electricity can kill, safe electrical isolation must be adhered to




1. FIND WHITE WIRE ON Y PLAN VALVE
2. LINKED INTO THE WHITE WILL BE ANOTHER WIRE.....THIS WILL BE **CALLING** FROM THE ROOM STAT
3. YOU HAVE NOW FOUND THE ROOM STAT CABLE!
4. THERE MIGHT BE OTHER WIRES IN THE CABLE, ONE NORMALLY BEING THE **NEUTRAL**.
5. THE OTHER WIRE WILL BE THE COMMON.
6. LINKED INTO THE COMMON WILL BE **CENTRAL HEATING ON** FROM THE PROGRAMMER.
7. REMOVE THE ROOM STAT CABLE AND LINK THE **CENTRAL HEATING ON** WIRE AND THE **WHITE** WIRE TOGETHER.
8. YOU HAVE NOW INSTALLED THE WIRING FOR HIVE IN THE WIRING CENTRE.

All mandatory electrical checks must be carried out in line with current regulations and specific attention should be drawn to your companies Safe Working Practices.

All service checks required under regulation 26.9 should be followed at all times when working on gas appliances.



Electricity can kill, safe electrical isolation must be adhered to

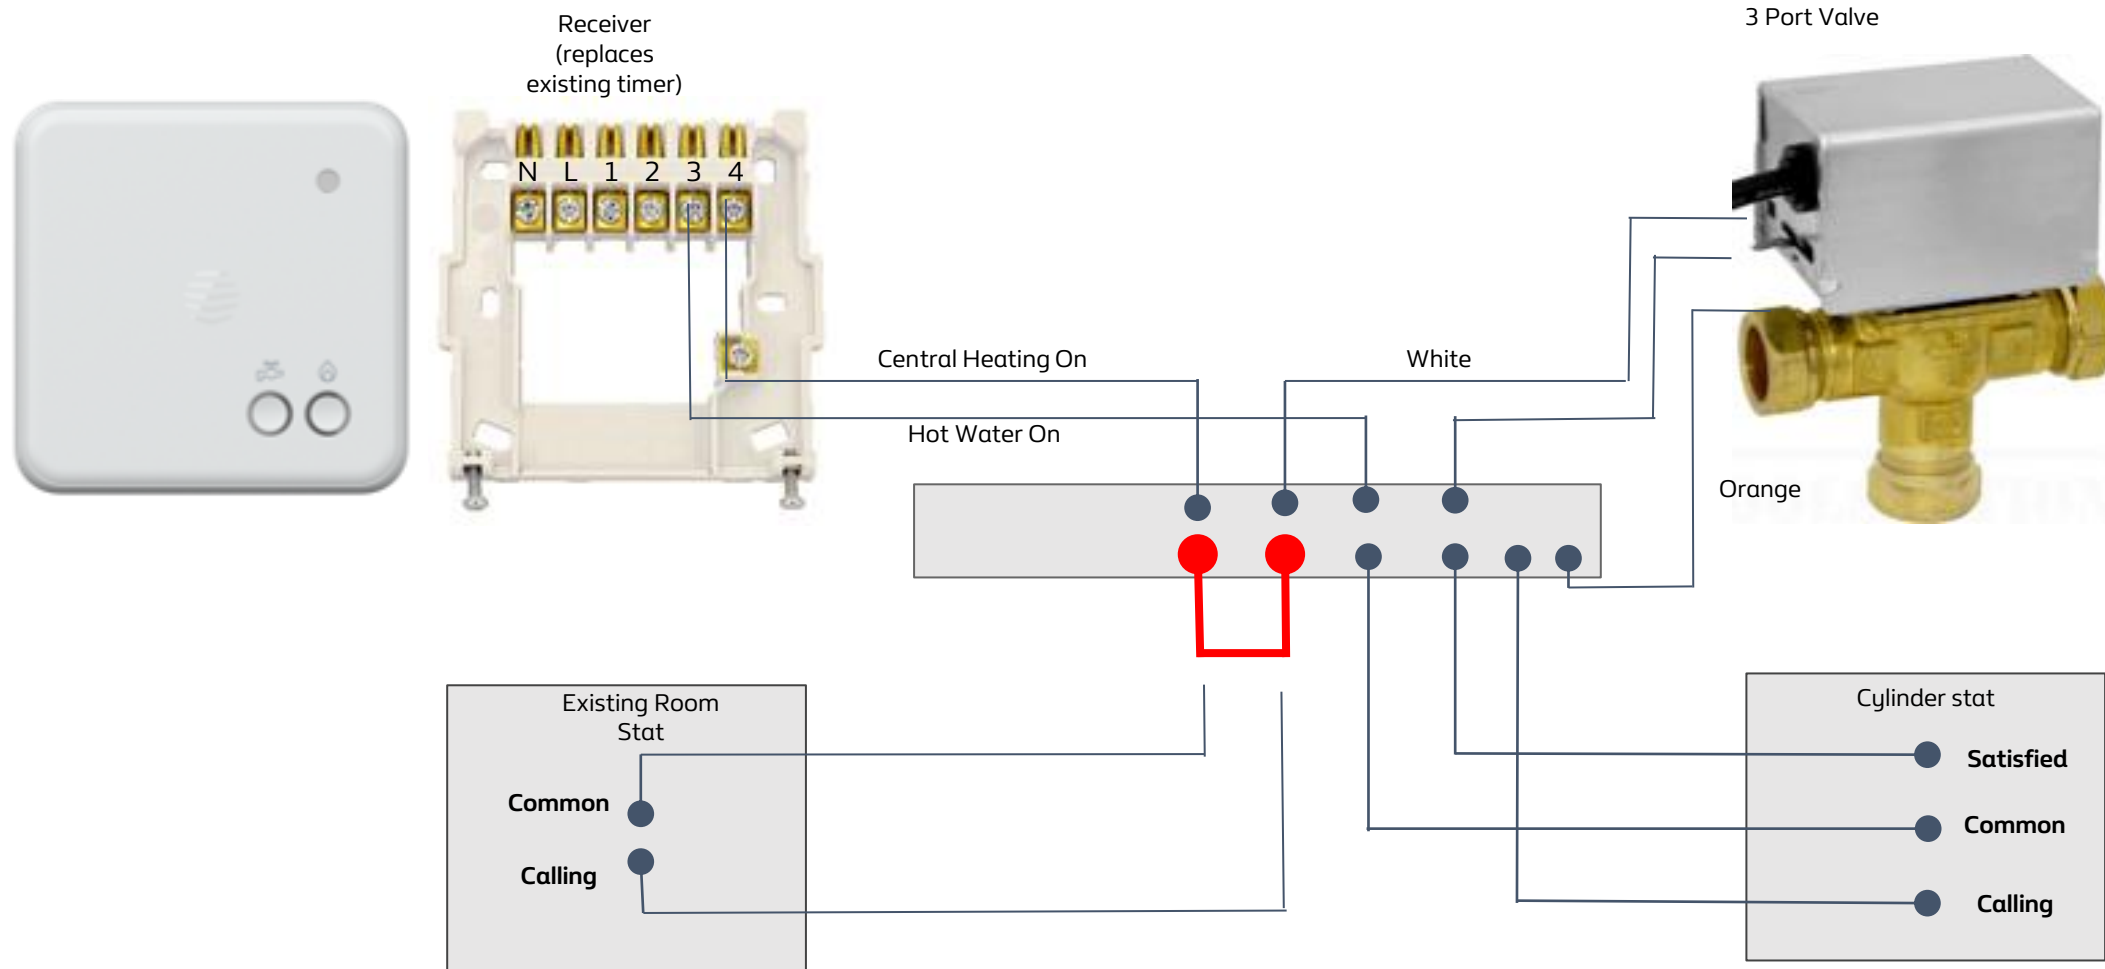

All mandatory electrical checks must be carried out in line with current regulations and specific attention should be drawn to your companies Safe Working Practices.
All service checks required under regulation 26.9 should be followed at all times when working on gas appliances.