

Installation Instructions



Collector Kits

*Collectors with Conetite Fittings
for use in Closed Circuit Drain Back Systems*

SPA2000, APA2007, CSA2007, CSA2013



ENVELOPE
SOLAR COLLECTOR



WARNING: Plumber – Be Aware

Use copper pipe ONLY. Plastic pipe **MUST NOT be used.**
It is a requirement of a solar water heater installation that all pipe work be in copper and not plastic, due to the effects of high water temperatures.

*This collector kit must be installed and serviced by a qualified person.
Please leave this guide with the householder.*



WARNING: Plumber – Be Aware

- The solar hot and solar cold pipes between the solar storage tank and the solar collectors **MUST BE** of copper. All compression fittings must use brass or copper olives.
- The full length of the solar hot and solar cold pipes **MUST BE** insulated.

The insulation must:

- be of a closed cell type or equivalent, suitable for a solar water heating application and capable of withstanding temperatures of up to 150°C, which may be generated by the solar collectors under stagnation conditions.

The specification of the chosen insulation material should be checked with the insulation manufacturer prior to installation as different materials may vary in temperature tolerance.

- be at least 13 mm thick, however thicker insulation may be required to comply with the requirements of either AS/NZS 3500.4 or AS/NZS 3500.5:2012 Section 3 (for a Class 1a or Class 10 building) as applicable under the Plumbing Code of Australia
- be weatherproof and UV resistant if exposed
- extend through any penetrations in the eaves, ceiling and roof
- cover valves and fittings in the solar pipe work
- be fitted up to and cover the connections on both the solar storage tank and the solar collectors.

The insulation is essential to assist in providing freeze protection, will offer protection to a metal roof against corrosion due to water running off the copper pipes, assist in avoiding accidental contact with the solar pipe work as very high temperature closed circuit fluid can flow from the solar collectors to the solar storage tank, and also reduce pipe heat losses.

Plumber: It is important to refer to and read in full the complete “Warning: Plumber – Be Aware” statement commencing on page 14.

CONTENTS

HOUSEHOLDER - This installation instruction booklet is intended for the installer but you may find it of interest.

Components And Kit Contents	4
System Installation	6
Installation – Solar Storage Tank.....	8
Installation – Solar Collectors	9
Roof Assembly Of Solar Collectors	19
Connection Details	29
Pipe Work Roughing In Dimensions.....	37
Exploded Views – Solar Collectors.....	40
Warranty Note	43

**Notice to Victorian Customers from the
Victorian Plumbing Industry Commission.**

**This water heater must be installed by a licensed person
as required by the Victorian Building Act 1993.**

Only a licensed person will give you a Compliance Certificate, showing that the work complies with all the relevant Standards. Only a licensed person will have insurance protecting their workmanship for 6 years. Make sure you use a licensed person to install this water heater and ask for your Compliance Certificate.

COMPONENTS AND KIT CONTENTS

SOLAR COLLECTOR KITS – CONETITE FITTINGS

For installation with a solar storage tank with a drain back heat exchanger.

Your solar water heater is designed for the solar collectors to be roof mounted and the solar storage tank to be installed at ground or floor level. The collector kits are suitable for:

Collector Kit – Envelope Conetite Fittings (1 solar collector)

12103011 SPA2000, APA2007, CSA2007, CSA2013 solar collectors

Collector Kit – Envelope Conetite Fittings (2 solar collectors)

12103012 SPA2000, APA2007, CSA2007, CSA2013 solar collectors

Collector Add On Kit – Envelope Conetite Fittings (3 solar collectors)

12103013 SPA2000, APA2007, CSA2007, CSA2013 solar collectors

WARNINGS

 **Warning:** Only use the coated brass fittings supplied as part of a closed circuit system. Uncoated brass conetite fittings should not be used.

 **Warning:** This parts kit shall not be used with an open circuit system.

Part No	Kit Components and Description	12103011 one collector	12103012 two collectors	12103013 three collectors
207511	Installation instructions roof kit	1	1	1
204411	Collector rail (1000 mm)	2	-	-
204412	Collector rail (1650 mm)	-	2	-
204413	Collector rail extension (1068 mm)	-	-	2
204600	Collector straps	4	4	2
331844	Drive cleat	-	-	2
204421	Collector clamps	4	8	4
209102	Tee bolt S/S M8 x 20	4	8	4
209118	Nut SS M8 x 1.25 mm	4	8	4
209124	Washer M8 SS flat	4	8	4
203000	Collector connector (collector union)	-	2	2
340450	Connector inlet / outlet drain back assembly - consisting of: 1 x connector pipe 1 x 331656 compression olive brass ½" 1 x 331655 compression nut ½"	2	2	-
337135	Collector bung assembly - consisting of: 1 x 337116 gland nut 1 x 337132 collector bung	1	1	-
340440	Hot sensor housing – temperature well	1	1	-
337116	Gland nut ¾"	1	1	-
346080 or 346081	Hot sensor assembly drain back	1	1	-
123204	Label hot pipe / cold pipe	1	1	-
348071	Cable ties 150 mm long	10	10	-

SYSTEM INSTALLATION

THIS WATER HEATER IS NOT SUITABLE FOR POOL HEATING.

The system is suitable for installation with SPA2000, APA2007, CSA2007 and CSA2013 solar collectors as part of a closed circuit system installation.

IMPORTANT NOTES

- Working on roofs is and should always be considered a hazardous activity, particularly early in the morning, late in the evening, when the roof is wet and during and after periods of rain.
- All work must be carried out in accordance with Local, State and Federal Occupational Safety, Health and Welfare Regulations. In particular, the requirements for safety whilst manual lifting, working at heights and on roofs.
- Installers must be competently trained in:
 - Height Hazard Assessment
 - Working at Height Procedures
 - Assessment / Use / Wearing of correct height safety equipment (harnesses etc.)
 - All other relevant safety factors specific to the installation and maintenance work to be compliant with suitable Occupational, Health and Safety Regulations / Codes.
- All relevant permits shall be obtained from the regulatory authorities before commencing work to install the solar hot water system.
- All work carried out must be performed by appropriately qualified tradespeople or be suitably supervised for trades assistant duties.
- Every care must be taken to protect and warn occupants of the building and the public from personal injury which may occur from falling tools, roof materials, fittings or any other hazards of a general nature.
- Advise the occupants of any inconvenience which may occur due to disconnection of existing water and electrical supplies.
- The connection, attachment, integration or general association of other equipment or parts which either directly or indirectly affect the operation or performance of this equipment could void the warranty.

INSTALLATION STANDARDS

The water heater must be installed:

- by a qualified person, and
- in accordance with the installation instructions, and
- in compliance with Standards AS/NZS 3500.4 or AS/NZS 3500.5:2012 Section 3 (for a Class 1a or Class 10 building) as applicable under the Plumbing Code of Australia, AS/NZS 3000 and all local codes and regulatory authority requirements.

In New Zealand, the installation must also conform to Clause G12 of the New Zealand Building Code.

WATER HEATER APPLICATION

This water heater is designed for use in a single family domestic dwelling for the purpose of heating potable water. Its use in an application other than this may shorten its life.

If this water heater is to be used where an uninterrupted hot water supply is necessary for the application or business, then there should be back-up redundancy within the hot water system design. This should ensure the continuity of hot water supply in the event that this water heater was to become inoperable for any reason. We recommend you provide advice to the system owner about their needs and building back-up redundancy into the hot water supply system.

CLOSED CIRCUIT SYSTEM INSTALLATION

A closed circuit system has a collector circuit which is separate from the potable water in the solar storage tank. Closed circuit fluid circulates through and collects heat from the solar collectors before circulating through a heat exchanger, where the heat is transferred to the potable water of the solar storage tank.

 **Warning:** Only use the coated brass fittings supplied as part of a closed circuit system. Uncoated brass conetite fittings should not be used.

Freeze Protection

The system is suitable for installation in areas subject to frost or freeze conditions. The solar circuit must be installed with a continuous fall of a minimum 5° (1 in 10 grade) in the pipe work from the solar collectors to the solar storage tank, with the full length of the solar hot and solar cold pipes insulated and the system charged with correctly mixed closed circuit fluid to offer protection against freeze damage (refer to **“Warning: Plumber Be Aware”** on page 14). Freeze conditions occur below 6°C.

The system has NO WARRANTY for freeze damage if there is not a continuous fall in the solar hot and solar cold pipes, or they are not insulated in accordance with the installation instructions, or the closed circuit fluid has been incorrectly mixed (refer to **“Warranty Note”** on page 43).

INSTALLATION – SOLAR STORAGE TANK

SOLAR WATER HEATER STORAGE TANK LOCATION

The solar storage tank should be installed close to the most frequently used outlet and its position chosen with safety and service in mind.

Consideration must also be given to the position of the solar storage tank in relation to the solar collectors. There are limitations on both the maximum length of the solar hot and solar cold pipes and the maximum height between the solar storage tank and the solar collectors. Refer to “[Solar Collector Location](#)” on page 9, to “[Pipe Lengths](#)” on page 12, to “[Maximum Height to Collectors – 270 Litre Tank](#)” on page 16 and to “[Maximum Height to Collectors – 160 Litre Tank](#)” on page 17.

Refer to the installation instructions supplied with the solar storage tank for installation details of the solar storage tank.

INSTALLATION – SOLAR COLLECTORS

SOLAR COLLECTOR LOCATION

Consideration must be given to the position of the solar collectors in relation to the solar storage tank. There are limitations on both the maximum length of the solar hot and solar cold pipes and the maximum height between the solar storage tank and the solar collectors. Refer to “Solar Storage Tank Location” on page 8, to “Pipe Lengths” on page 12, to “Maximum Height to Collectors – 270 Litre Tank” on page 16 and to “Maximum Height to Collectors – 160 Litre Tank” on page 17.

The solar collectors must be installed in a shade free position. The surrounds should be checked for higher buildings or trees which may cause shade at other times of the year and for small trees which may grow and shade the solar collectors in the future.

The installation must comply with the requirements of either AS/NZS 3500.4 or AS/NZS 3500.5:2012 Section 3 (for a Class 1a or Class 10 building) as applicable under the Plumbing Code of Australia, and all local codes and regulatory authority requirements.

Refer to the installation instructions supplied with the solar storage tank for details on the installation of the solar storage tank.

ROOF STRENGTH

The installer must ensure the structural integrity of the building is not compromised by the solar water heater installation and the roof structure is suitable to carry the full weight of the solar collectors and frame (if one is installed). If in any doubt of the construction or the condition of the roof, the roof should be suitably strengthened. Consult a structural engineer. Each solar collector and its fittings can weigh up to approximately 55 kg when full of closed circuit fluid.

ROOF AREA FOR INSTALLATION

Roof area required for solar collectors:

- 3 solar collectors – 3.4 m wide x 2.0 m deep. Weight (full) 165 kg approx.
- 2 solar collectors – 2.3 m wide x 2.0 m deep. Weight (full) 110 kg approx.
- 1 solar collector – 1.2 m wide x 2.0 m deep. Weight (full) 55 kg approx.

In addition to this area, a minimum one (1) metre clearance is recommended on all four sides of the solar collectors for safe service access.

Maximum Number of Collectors

The maximum recommended number of collectors for each tank size as part of a closed circuit system are:

- 270 tank – 3 x SPA2000, APA2007, CSA2007, CSA2013 collectors
- 160 tank – 2 x APA2007, CSA2007, CSA2013 collectors

ORIENTATION OF SOLAR COLLECTORS

To help maximise system performance, solar collectors should be installed with an optimum orientation facing true north (in the southern hemisphere) or true south (in the northern hemisphere). Always check for true north or true south using a compass or other suitable device.

The solar performance of a system reduces as the orientation of the collectors moves away from the optimum orientation, resulting in the need for increased boosting to supply the same hot water load. Solar collectors facing up to 45° from the optimum orientation will receive about 4% to 5% less total solar radiation.

However, the optimum orientation of solar collectors is not always practical or achievable. Solar collectors may be installed up to 90° from the optimum orientation. Where the orientation is greater than 60° from the optimum, it may be possible for an additional solar collector to be installed or to install selective surface collectors in lieu of non-selective surface collectors to help make up for the reduction in solar performance compared to the optimum orientation. Each option should be discussed with the system owner.

If neither of these options are possible nor acceptable to the system owner, then the system owner needs to be made aware of, understand and accept that increased boosting may be required to meet their hot water requirements.

INCLINATION OF SOLAR COLLECTORS

To help maximise system performance, solar collectors should be installed with an optimum inclination. This is equal to 90% to 100% of the local latitude angle when collectors are oriented within 60° of true north or true south, and between 10° and 20° when the collectors are oriented between 60° and 90° from the optimum orientation.

Generally, improved summer performance is obtained from an angle of inclination less than the optimum angle and improved winter performance is obtained by an angle of inclination greater than the optimum angle. If the angle of inclination varies by 20° from the optimum angle, the solar collectors will receive about 10% less total annual solar radiation. The [latitude of some Australian cities](#) are listed on page 12.

However, the optimum inclination of solar collectors is not always practical or achievable. Solar collectors may be installed at the roof angle for simplicity of installation and appearance, but must never be less than 10° from the horizontal for a closed circuit drain back system.

The collector kit is suitable for installations with an inclination of up to 45°. Where the solar collectors are installed at inclinations greater than 45°, a With Pitch frame is necessary. Refer to your local Solar Distributor for details.

A Variable Pitch frame can be installed to increase the angle of inclination of the collectors used in a solar pumped water heater installation. This type of frame should be used if the roof pitch either varies by more than 20° from the optimum angle or is less than 10°.

The use of a Variable Pitch frame should be discussed with the system owner. If this option is neither possible nor acceptable to the system owner, it may be possible for an additional solar collector to be installed or to install selective surface collectors in lieu of non-selective surface collectors to help make up for the reduction in solar performance compared to the optimum inclination. Each option should be discussed with the system owner.

If these options are neither possible nor acceptable to the system owner, then the system owner needs to be made aware of, understand and accept that increased boosting may be required to meet their hot water requirements.

CYCLONIC OR HIGH WIND AREAS

For an installation of solar collectors on a pitched roof in a cyclonic or high wind area, a suitable With Pitch frame is required. Refer to your local Solar Distributor for details.

The installation of these solar collectors on a suitable frame, subject to the frame’s design criteria not being exceeded:

- may be suitable for installation in geographic locations up to and within Wind Region D (With Pitch frame) or up to and within Wind Region C (Variable Pitch frame), as defined in the Building Code of Australia, Australian Standard AS 4055 and the Australian / New Zealand Standard AS/NZS 1170.2, or equivalent locations, and
- may provide an acceptable method of installation where it is necessary to satisfy the requirements of the Building Code of Australia for high wind areas, or equivalent requirements.

LATITUDE OF SOME AUSTRALIAN CITIES

Adelaide	35°S	Cairns	17°S	Hobart	42°S	Port Hedland	20°S
Alice Springs	24°S	Canberra	35°S	Mildura	34°S	Rockhampton	24°S
Brisbane	27°S	Darwin	12°S	Melbourne	38°S	Sydney	34°S
Broken Hill	31°S	Geraldton	28°S	Perth	32°S	Townsville	19°S

PIPE LENGTHS

The solar hot and solar cold pipes between the solar storage tank and the solar collectors shall:

- be of bendable grade or hard drawn copper tube.
Annealed or soft copper shall not be used.
- have a continuous fall from the solar collectors to the solar storage tank of a minimum 5° (1 in 10 grade) and be of a design to ensure complete drain back of the closed circuit fluid.

Care must be taken to ensure the pipe work maintains a continuous fall over the life of the installation. Pipe work should be fixed at regular intervals to assist in maintaining this requirement.
- not exceed the maximum recommended combined lengths as specified in the table.

Maximum recommended total combined pipe length (solar hot + solar cold) and number of 90° bends						
Pipe Size	1 Collector		2 Collectors		3 Collectors	
	Pipe Length	90° Bends	Pipe Length	90° Bends	Pipe Length	90° Bends

270 litre closed circuit system

SPA2000, APA2007, CSA2007, CSA2013

DN15	40 m	20	40 m	20	30 m	20
------	------	----	------	----	------	----

160 litre closed circuit system

APA2007, CSA2007, CSA2013

DN15	30 m	15	30	15	NA	NA
------	------	----	----	----	----	----

For each additional 90° bend, reduce the maximum total pipe length by 0.5 m.

For each additional metre of pipe length, reduce the number of 90° bends by two.

Note: One 90° elbow is equal to two 90° bends.

NA – not available.

Notes:

- It is important to connect the solar hot and solar cold pipes to the correct connections at the solar collectors and at the solar storage tank.
- The solar cold pipe connects to the bottom of the solar collector array and may connect to either the left or right hand side. The solar hot pipe must connect to the top of the solar collector array diagonally opposite to the solar cold pipe connection. The solar hot outlet connection is to be the highest point of the system.
- The lowest corner of the solar collector installation in a closed circuit system, which is where the solar cold pipe connects to the collector array, should be the corner closest to the solar storage tank. This will maximise the gradient for the continuous fall of the solar cold pipe, by providing a shorter lateral distance for the vertical fall of pipe work.
- The hot sensor connection is at the top of the solar collector array, directly above the solar cold inlet connection for this closed circuit system.
- Refer to **“Warning: Plumber – Be Aware”** on page 14.

It is essential for these requirements to be followed for the system to operate correctly and efficiently. Solar pipe work which is oversized, or is too long, or does not have the correct fall can result in a reduction in performance or the drain back system not operating effectively.



WARNING: Plumber – Be Aware

- The solar hot and solar cold pipes between the solar storage tank and the solar collectors **MUST BE** of copper. All compression fittings must use brass or copper olives.
- The full length of the solar hot and solar cold pipes **MUST BE** insulated.

The insulation must:

- be of a closed cell type or equivalent, suitable for a solar water heating application and capable of withstanding temperatures of up to 150°C, which may be generated by the solar collectors under stagnation conditions

The specification of the chosen insulation material should be checked with the insulation manufacturer prior to installation as different materials may vary in temperature tolerance.

- be at least 13 mm thick, however thicker insulation may be required to comply with the requirements of either AS/NZS 3500.4 or AS/NZS 3500.5:2012 Section 3 (for a Class 1a or Class 10 building) as applicable under the Plumbing Code of Australia
- be weatherproof and UV resistant if exposed
- extend through any penetrations in the eaves, ceiling and roof
- cover valves and fittings in the solar pipe work
- be fitted up to and cover the connections on both the solar storage tank and the solar collectors.

The insulation is essential to assist in providing freeze protection, will offer protection to a metal roof against corrosion due to water running off the copper pipes, assist in avoiding accidental contact with the solar pipe work as very high temperature closed circuit fluid can flow from the solar collectors to the solar storage tank, and also reduce pipe heat losses.

- The insulated copper pipe work:
 - should be fixed at suitable locations to prevent or reduce the possibility of noise from water hammer and vibration from occurring
 - is not to be placed or installed in contact with plastic pipe work.

Likewise, plastic pipe work is not to be placed or installed in contact with the insulated copper pipe work after the solar circuit is installed.



WARNING: Plumber – Be Aware

- The highest point of the solar hot and solar cold pipes must be where they connect to the solar collectors. There **MUST BE a continuous fall** of a minimum 5° (1 in 10 grade) in the pipe work from the solar collectors to the solar storage tank for efficient and complete drain back of the closed circuit fluid to occur.

The system has NO WARRANTY for freeze damage if there is not a continuous fall in the solar hot and solar cold pipes, or they are not insulated in accordance with the installation instructions, or the closed circuit fluid has been incorrectly mixed.

- Plastic pipe **MUST NOT** be used, as it will not withstand the temperature of the closed circuit fluid generated by the solar collectors under stagnation conditions. Extremely high closed circuit fluid temperatures up to 150°C for non-selective surface collectors and greater than 200°C for selective surface collectors can be generated under these conditions. Plastic pipe cannot withstand these temperatures and **MUST NOT** be used. Failure of plastic pipe can lead to the release of high temperature water or closed circuit fluid and cause severe water damage and flooding.
- The pressure applied to the solar circuit and solar collectors during a pressure test of a closed circuit system **MUST NOT** exceed 200 kPa, otherwise damage may result.

Refer to “[Pressure Testing](#)” on page 18.


- Upon completion of the installation of the solar collectors with conetite fittings, the packaging material may be removed whether or not the solar circuit is connected to the solar storage tank and / or the solar water heater is commissioned, without damage to the solar collectors.

Maximum Height to Collectors – 270 Litre Tank

The solar collectors must be the highest point of the system. The maximum height of the solar installation, from the base of the 270 litre solar storage tank to the top of the solar collectors, is 9 m for this closed circuit system. The pump supplied will not circulate closed circuit fluid through heights greater than 9 m and solar gain will not be achieved.

For heights greater than 9 m, an auxiliary pump (kit PN 299914) must be installed above and within 1 m of the solar storage tank. The installation of an auxiliary pump will enable a maximum height of 18 m to be achieved. Refer to the installation instructions supplied with the solar storage tank for further details.

Note: The top of the solar storage tank must be a minimum of 500 mm below the bottom of the solar collectors for the system to operate correctly.

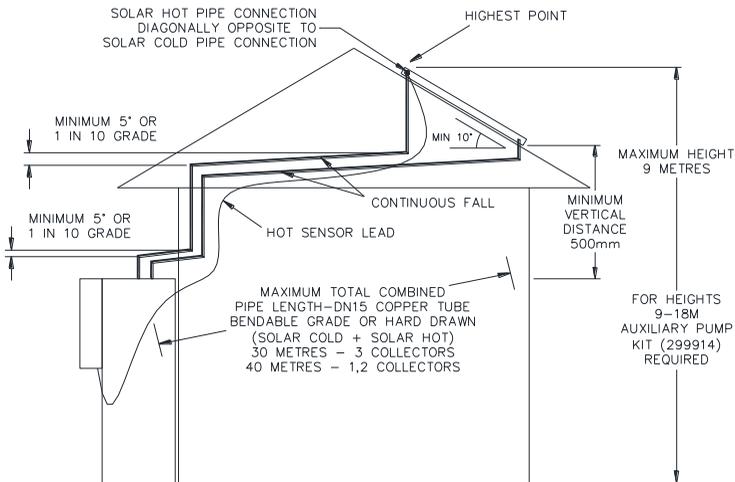

NOTES:

- PIPE WORK MUST HAVE A CONTINUOUS FALL OF NOT LESS THAN 5' (1 IN 10 GRADE) FROM THE SOLAR COLLECTORS TO THE SOLAR STORAGE TANK.
- PIPE WORK MUST BE OF BENDABLE GRADE OR HARD DRAWN DN15 COPPER TUBE. ANNEALED OR SOFT COPPER SHALL NOT BE USED.
- THE LOWEST CORNER OF THE SOLAR COLLECTOR INSTALLATION (SOLAR COLD CONNECTION) SHOULD BE THE CORNER CLOSEST TO THE SOLAR STORAGE TANK.
- INSTALL HOT SENSOR LEAD WITH INSULATED SOLAR PIPES DURING CONSTRUCTION FOR NEW HOMES.
- PRESSURE TESTING OF SOLAR COLLECTORS AND SOLAR CIRCUIT MUST NOT EXCEED 200Kpa.


Closed Circuit System – Drain Back Solar 270 Litre Tank Pipe Work Installation Requirements

Maximum Height to Collectors – 160 Litre Tank

The solar collector must be the highest point of the system. The maximum height of the solar installation, from the base of the solar storage tank to the top of the solar collector, is 7.5 m for this closed circuit system. The pump supplied with the solar storage tank will not circulate closed circuit fluid through heights greater than 7.5 m and solar gain will not be achieved.

An additional or auxiliary pump cannot be added to this system, nor can the pump supplied with the system be replaced with another pump, to increase the maximum height of the system.

Note: The top of the solar storage tank must be a minimum of 500 mm below the bottom of the solar collector for the system to operate correctly.

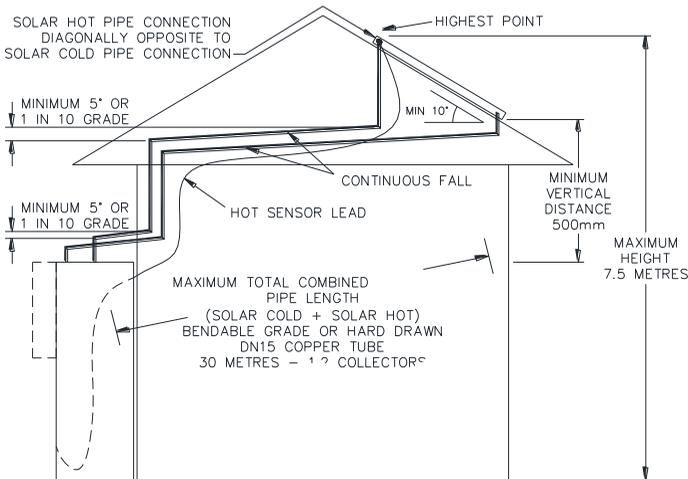

NOTES:

- PIPE WORK MUST HAVE A CONTINUOUS FALL OF NOT LESS THAN 5° (1 IN 10 GRADE) FROM THE SOLAR COLLECTORS TO THE SOLAR STORAGE TANK.
- PIPE WORK MUST BE OF BENDABLE GRADE OR HARD DRAWN DN15 COPPER TUBE. ANNEALED OR SOFT COPPER SHALL NOT BE USED.
- THE LOWEST CORNER OF THE SOLAR COLLECTOR INSTALLATION (SOLAR COLD CONNECTION) SHOULD BE THE CORNER CLOSEST TO THE SOLAR STORAGE TANK.
- INSTALL HOT SENSOR LEAD WITH INSULATED SOLAR PIPES DURING CONSTRUCTION FOR NEW HOMES.
- PRESSURE TESTING OF SOLAR COLLECTOR AND SOLAR CIRCUIT MUST NOT EXCEED 200KPa.

Closed Circuit System – Drain Back Solar 160 Litre Tank Pipe Work Installation Requirements

Pressure Testing

The solar water heater, including the collector circuit, is to be isolated during the testing and commissioning of the heated water reticulation system in a building in accordance with Clause 9.3 (a) of AS/NZS 3500.4:2015 or Clause 3.34.2 (a) of AS/NZS 3500.5:2012 for a Class 1a or Class 10 building as applicable under the Plumbing Code of Australia. The collector circuit includes the solar hot and solar cold pipes and solar collectors.

It may be necessary to pressure test the collector circuit to comply with codes and regulatory authority requirements or on other occasions where the solar collectors and solar hot and solar cold pipes are installed prior to the solar storage tank, such as on a building site.

Collector Circuit

⚠ Warning: The pressure applied to the collector circuit during a pressure test of a closed circuit system **MUST NOT** exceed 200 kPa, otherwise damage may result to the SPA2000 solar collectors. The solar circuit and solar collectors are to be isolated from the solar storage tank for the duration of the pressure test.

SPA2000 Solar Collector Installations

If water is used as the pressure testing medium and if the collector circuit is not to be connected to the solar storage tank and the system commissioned on the same day, then any excess moisture needs to be blown out and the collector circuit and solar collectors dried using dry compressed air.

It is necessary to cap off the ends of the solar hot and solar cold pipes if they are not connected to the solar storage tank at the time of installation and at the time of testing the solar circuit.

Closed Circuit System

If the solar collectors, solar pipe work and solar storage tank are installed and commissioned together, then the flooding of the collector circuit with closed circuit fluid for a closed circuit system and checking the pipe work for leaks during the commissioning procedure can be substituted for the pressure testing of the collector circuit.

ROOF ASSEMBLY OF SOLAR COLLECTORS

Notes:

- These solar collectors have passed the AS/NZS 2712 requirements for resistance to hailstone damage, so it is not normally necessary to fit a guard to a collector. Stone Guards are available to provide a level of protection to the collectors against vandalism or accidental damage. Refer to your local Solar Distributor for details.
- Warranty **DOES NOT** cover breakage of solar collector glass. Check your insurance policy covers collector glass breakage.

⚠ Warning: No attempt should be made to remove or replace broken collector glass.

The collector glass is not offered as a replacement part. Should the solar collector require replacement, contact your local Solar Distributor for details.

- **⚠ Warning:** Do not remove the solar collector packaging completely, prior to the installation as the solar collector surface can become very hot. Remove only sufficient packaging material to enable the installation of the solar collectors.

Upon completion of the installation of the solar collectors with conetite fittings, such as on a building site, the packaging material may be removed whether or not the solar circuit is connected to the solar storage tank and / or the solar water heater is commissioned, without damage to the solar collectors.

The solar collector packaging must be removed completely prior to the permanent operation of the water heater.

- All connectors, unions, end plugs, brass fittings, collector straps and collector rails required for the installation are included with the collector kit. Suitable screws or anchors will be required to fix the collector straps to the rafters for a pitched roof installation.
- Tee bolts, collector clamps, washers and nuts to secure the solar collectors to the collector rails are included with the collector kit.
- All olive compression fittings must use brass or copper olives. Use an approved thread sealant such as Teflon tape on all other threaded joints. Conetite fittings do not require a thread sealant.
- **Roof Condition:** Check the condition of the roof and advise the client of any broken tiles or damaged roof sheeting before commencing the installation.

Numbers in parentheses refer to items in the diagrams on page 40 ([one solar collector installation](#)), page 41 ([two solar collector installation](#)) and page 42 ([three solar collector installation](#)).

DO NOT MODIFY THESE PARTS IN ANY WAY

1. **Solar Frame:** If a solar frame is to be installed, determine the location of the frame(s). Refer to "[Solar Collector Location](#)" on page 9 and the installation instructions provided with the frame(s).

Assemble and fix the frame(s) to the roof in accordance with the installation instructions provided with the frame.

Depending upon the positioning of the frame on the roof and any minor fall the roof may have, ensure the collector rail is at the correct angle from the horizontal to achieve the required fall across the solar collectors. If in doubt use a spirit level.

Proceed to step 4.

2. **Solar Collector Location:** If a solar frame is not installed, select a suitable position for the solar collectors. Refer to "[Solar Collector Location](#)" on page 9.
3. **Collector Rail (bottom) – Pitched Roof Installation:** Determine the location of the bottom collector rail(s) (1). If more than two solar collectors (17) are installed, locate the collector rail (1) from the Collector Add On kit(s) adjacent to the first collector rail (1) and join together using the drive cleat (8) supplied in the Collector Add On kit.

Note: The collector straps (2) are to be fitted to the collector rail(s) (1) before fixing the straps to the rafters.

Determine which slots in the bottom collector rail(s) (1) will be used for the collector straps (2). Hook two collector straps (2) to the first bottom collector rail (long) (1) and one collector strap (2) to the additional bottom single collector rail (short) (1) (if used).



Refer to "[Hooking Collector Strap to Collector Rail](#)" on page 29 and [Detail A](#) on page 30.

The solar collectors (17) must be installed at an angle from the horizontal for a drain back closed circuit system. Ensure the end of the collector rail (1) at the outlet side of the solar collectors is higher up the roof than the end of the collector rail at the inlet side of the solar collectors by:

- 10 – 15 mm (for one solar collector), or
- 20 – 30 mm (for two solar collectors), or
- 30 – 45 mm (for three solar collectors).

This is to ensure there is sufficient angle:

- for the hot sensor housing to be completely surrounded by closed circuit fluid when the pump is on, and
- to assist in complete drain back of closed circuit fluid from the solar collectors in a closed circuit system.

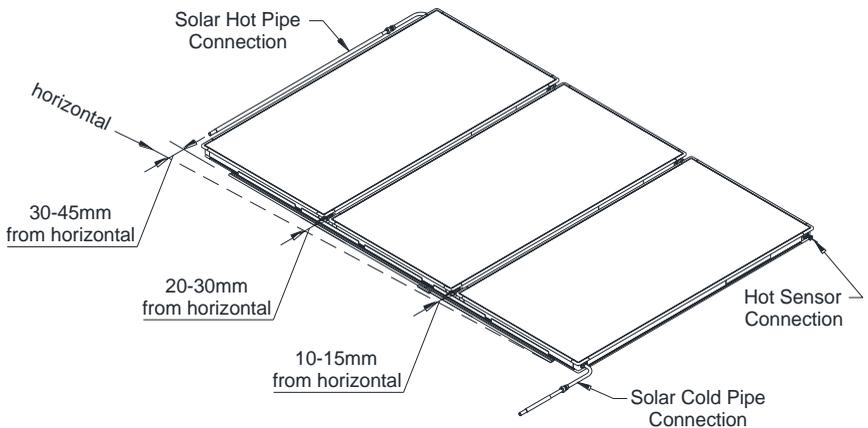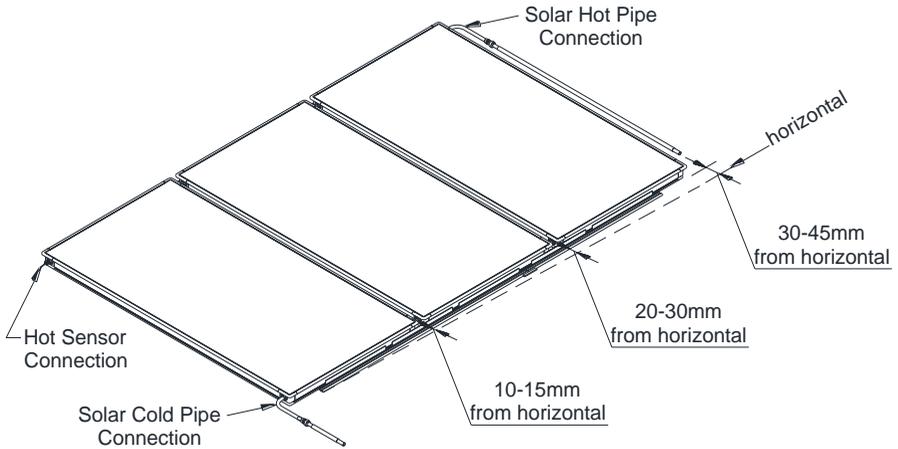

NOTES:

- If the roof material is not even where the collectors are to be installed, then it may be necessary to add 10mm for each collector in the array to these distances.
- The lowest corner of the solar collector installation should be the corner closest to the solar storage tank.

Collector Angle From Horizontal

Failure to adhere to this requirement may result in both an air pocket surrounding the hot sensor housing during the pumping cycle resulting in an incorrect hot sensor operation and incomplete drain back of closed circuit fluid when the pump deactivates.

If the roof material is not even where the collectors are to be installed, then it may be necessary to add 10 mm for each collector in the array to the above distances. It is important that the solar hot outlet is higher than the hot sensor housing so the system functions efficiently.

The lowest corner of the solar collector installation in a closed circuit system, which is where the solar cold pipe connects to the collector array, should be the corner closest to the solar storage tank. This will maximise the gradient for the continuous fall of the solar cold pipe, by providing a shorter lateral distance for the vertical fall of pipe work.

Note: Refer also to “*Tile Roof with a flat tile profile*” on page 22 if the installation is on a tile roof where the tile has a flat profile. Additional requirements for the positioning of the collector rail and installation of the solar collectors apply.

Tile Roof with a flat tile profile: If the installation is on a tile roof with a flat tile profile, the solar collectors (17) must be installed at an increased angle from the horizontal to also assist in rainwater runoff. The solar hot outlet side must be on the left hand side and the solar cold inlet must be on the right hand side of the collector array.


The top end of the solar collector on the solar cold inlet side must sit atop the lower end of a tile lap. Measure down the roof approximately 1960 mm from this point to determine the position of the bottom collector rail.

Ensure the end of the collector rail (1) at the outlet side (left hand side) of the solar collectors is higher up the roof than the end of the collector rail at the inlet side (right hand side) of the solar collectors by:

- 15 – 20 mm for one solar collector, or
- 30 – 40 mm for two solar collectors, or
- 45 – 60 mm for three solar collectors.

This is to provide a downward angle along the top end of the collectors to assist in rainwater runoff in order to prevent pooling.

Failure to adhere to this requirement may result in pooling of rainwater at the top of the collectors. If the top end of the collector array is too close to the lap of the tiles, there is a risk of pooling water seeping up and under the tile lap. The rainwater runoff is to flow from left to right to reduce the risk of water working through the joints between tiles.

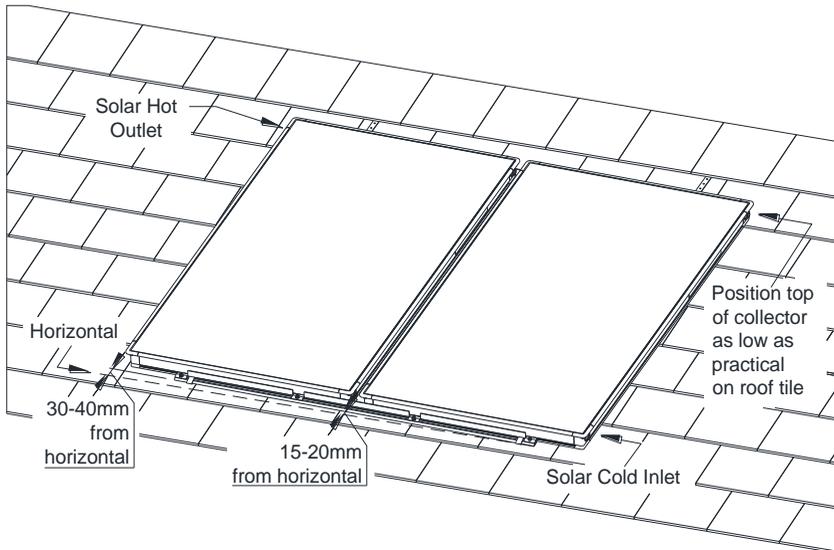

Flat Tile Roof Profile – Collector Angle From Horizontal

Tile Roof: Remove the tiles on the next row above the position of the collector rail (1) to expose the rafters. Ensure the collector rail (1) is at the correct angle from the horizontal. Once in position, fix the collector straps (2) directly to the rafters, using suitable screws or anchors. Replace the tiles.

Metal Roof: Ensure the collector rail (1) is at the correct angle from the horizontal. Once in position, fix the collector straps (2) to the rafters, through the metal roofing material, using suitable screws or anchors. Care should be taken not to mark Colorbond or other metal roof sheet with a marking pen and to remove all swarf from the metal roof as these can cause deterioration of the metal roofing material.

Note: Fixings must penetrate only through the high point in the roof material profile. AS/NZS 3500.4 states a minimum of three (3) screws 40 mm long be used per fixing strap. Longer screws or anchors may be required to achieve a 40 mm minimum embedment into rafters for a metal roof. Additional screws or anchors may be required.

4. **Solar Collectors:** Using a lifting device, lift the first solar collector (17) onto the roof and place it carefully with the lower end seated in the collector rail (1) and prior to positioning the next solar collector, firmly clamp (two clamps per collector) to the collector rail using the Tee bolts (13), collector clamps, washers and nuts provided.

Repeat this procedure for additional collectors (17), firmly clamping each collector to the collector rail (1) with two clamps (13) prior to positioning a subsequent collector.

Refer to “Clamping Collector to Collector Rail” on page 32.

Note: Firmly clamping each solar collector to the collector rail as it is placed in position reduces the possibility of the collector(s) accidentally moving or sliding off the collector rail.

Remove the red transit plugs from the collector sockets.

5. **Collector Unions:** Couple the solar collectors (17) together using the collector unions (3) supplied in the collector kit.

Refer to “Coupling Collector to Collector – Conetite Fittings” on page 31.

Note: It will be necessary to loosen the clamps on a collector prior to it being coupled to its adjacent collector. Secure the clamps again on each collector after it is coupled to the adjacent collector.

6. **Fixing Collector (Bottom):** Ensure the solar collectors (17) are correctly positioned, centred and well seated in the collector rail(s) (1).

Tighten the clamps (13) on each solar collector (17).

Refer to “Clamping Collector to Collector Rail” on page 32.

7. **Collector Rail (top) – Pitched Roof Installation:** If more than two solar collectors (17) are installed, at the top end of the solar collectors (17) locate the second collector rail (1) from the Collector Add On kit(s) adjacent to the first collector rail (1) and join together using the drive cleat (8) supplied in the Collector Add On kit.

Note: The collector straps (2) are to be fitted to the collector rail(s) (1) before fixing the straps to the rafters.

Determine which slots in the top collector rail(s) (1) will be used for the collector straps (2). Hook two collector straps (2) to the first top collector rail (long) (1) and one collector strap (2) to the additional top single collector rail (short) (1) (if used).

Refer to “Hooking Collector Strap to Collector Rail” on page 29 and **Detail B** on page 30.

Locate the top collector rail(s) (1) against and underneath the top end of the solar collectors.

Tile Roof: Remove the tiles on the next row above the position of the top collector rail (1) to expose the rafters. Once the collector rail (1) is in position, fix the collector straps (2) directly to the rafters, using suitable screws or anchors. Replace the tiles.

Metal Roof: Once the collector rail (1) is in position, fix the collector straps (2) to the rafters, through the metal roofing material, using suitable screws or anchors. The collector straps (2) may be cut to a length of approximately 100 mm to retain the aesthetics of the installation.

Note: Fixings must penetrate only through the high point in the roof material profile. AS/NZS 3500.4 states a minimum of three (3) screws 40 mm long be used per fixing strap. Longer screws or anchors may be required to achieve a 40 mm minimum embedment into rafters for a metal roof. Additional screws or anchors may be required.

8. **Fixing Collector (Top):** Ensure the solar collectors (17) are correctly positioned, centred and well seated in the collector rail (1).

Clamp the solar collectors (17) (two clamps per collector) to the collector rail (1), using the Tee bolts (13), collector clamps, washers and nuts provided.

Refer to “Clamping Collector to Collector Rail” on page 32.

9. **Connectors:** Fit a connector (10) to the inlet of the solar collector array and a connector (10) to the outlet of the solar collector array.

Refer to “Coupling Cold and Hot Pipes to Collector – Conetite Fittings” on page 35.

Note: If the SPA2000 solar collectors at the time of their installation, are not to be connected to the solar hot and solar cold pipes, such as on a building site, then it will be necessary to cap off each of the connectors (10) to prevent air from entering the solar collectors.

10. **Hot Sensor Housing:** Fit the hot sensor housing (4) to the collector connection above the inlet and opposite to the outlet of the solar collector array.

Refer to “Hot Sensor Housing Assembly – Conetite Fittings” on page 34.

11. **End Plug:** Fit the end plug (5) to the collector connection opposite the inlet connection and below the outlet of the solar collector array.

Refer to “End Plug Assembly – Conetite Fittings” on page 35.

12. **Solar Hot and Solar Cold Pipes:** Install the solar cold pipe from the solar storage tank to the solar collectors (17) and the solar hot pipe from the solar collectors (17) to the solar storage tank.

The solar hot and solar cold pipes must be of bendable grade or hard drawn copper and DN15 for a closed circuit system. Refer to “[Pipe Lengths](#)” on page 12.

The solar hot and solar cold pipes must have a continuous fall from the solar collectors to the solar storage tank. The fall must not be a minimum 5° (1 in 10 grade) for a closed circuit system.

The full length of the solar hot and solar cold pipes must be insulated. The insulation must be capable of withstanding the temperatures generated by the solar collectors under stagnation conditions.

⚠ Warning: Plumber – Be Aware: It is important you refer to “[Warning: Plumber – Be Aware](#)” on page 14 for further and important information relating to the installation of the solar hot and solar cold pipes.

Refer also to [installation diagrams on pages 40, 41 and 42](#) and to “[Pipe Work Roughing In Dimensions](#)” on page 37.

Notes:

- Penetrations through the roofing material must be:
 - at the high point of the roof tile or metal sheet
 - made neatly and kept as small as practicable
 - waterproofed upon installation of the solar hot and solar cold pipes.
- Exposed insulated pipe work between the solar collectors and the penetration through the roofing material should be kept to a minimum to maintain the aesthetics of the installation.

13. **Connecting the Solar Hot and Solar Cold Pipes to Collectors:** Connect the solar cold pipe to the connector (10) at the inlet of the solar collectors (17) and the solar hot pipe to the connector (10) at the outlet of the solar collectors (17) by either using the compression nuts (11) and olives (12) provided or brazing the pipe to the connector (10).

Note: The end of the connectors must be orientated downward, below the collector connection. This is to ensure complete drain back of the closed circuit fluid from the solar collectors in a closed circuit system.

Refer to “[Coupling Cold and Hot Pipes to Collector – Conetite Fittings](#)” on page 35 and the [installation diagrams on pages 41 and 42](#).

- If the SPA2000 solar collectors and the solar hot and solar cold pipes at the time of their installation are not to be connected to the solar storage tank, such as on a building site, then it will be necessary to cap off the ends both of the solar hot and solar cold pipes to prevent air from entering the solar collectors. Refer to “**Pressure Testing**” on page 18.

14. **Hot Sensor Lead – Collector Connection:** Ensure the well of the sensor housing (4) is dry and insert the sensor probe of the hot sensor lead assembly (9) into the sensor housing (4). Push the sensor probe all the way up to the end of the sensor housing. Lock it into position with the locking washer and clip provided.

Hot Sensor Lead – Solar Storage Tank Connection: Run the hot sensor lead down to the solar storage tank. An extension sensor lead is available if the hot sensor lead is not long enough to reach the solar storage tank.

270 litre tank – Connect the hot sensor lead to the hot sensor cable connecting socket located on the tab behind the upper front cover of the solar storage tank.

160 litre tank – Connect the hot sensor lead to the socket on the hot sensor lead from the solar control board located behind the front cover of the solar storage tank. Refer to the Owner’s Guide and Installation Instructions supplied with the solar storage tank connection detail.

15. **Cable Ties:** Secure the hot sensor lead at appropriate locations with the cable ties (14) provided.

Notes:

- The hot sensor lead may be cable tied to the outside of the insulation on the solar pipe work.
 - Ensure the hot sensor lead is not in direct contact with the solar pipe work at any point of the collector circuit, otherwise damage to the sensor lead can occur due to the high temperatures which can be experienced within the pipe work.
 - Damage to the hot sensor lead can result in solar gain not being achieved and the freeze protection system being rendered inoperative.
16. **Labels:** At ground or floor level, above the location of the solar storage tank, attach the ‘Solar Cold Pipe’ label (16) to the insulation on the solar cold pipe to the solar collectors and the ‘Solar Hot Pipe’ label (15) to the insulation on the solar hot pipe from the solar collectors.

Ensure the arrows on the labels are pointing in the correct direction of closed circuit fluid flow.

17. **Pressure Testing the Collector Circuit:** Upon completion of the solar collector and solar hot and solar cold pipe installation, it may be required to pressure test the collector circuit. Refer to “**Pressure Testing**” on page 18.
18. **Connecting the Solar Hot and Solar Cold Pipes to the Solar Storage Tank:** Refer to “Connections – Plumbing” in the Owner’s Guide and Installation Instructions supplied with the solar storage tank for details on the solar hot and solar cold pipe connections to the solar storage tank.
19. **Commissioning:** Upon completion of the installation, refer to the Owners Guide and Installation instructions supplied with the solar storage tank for the commissioning procedure of the solar water heater.

INSTALLATION CHECK LIST

Once the installation is complete, it is important to check the following for a closed circuit system:

- Ensure the collector rail is at the correct angle from the horizontal to achieve the required fall across the solar collectors.

The outlet side of the collector array is higher up the roof than the inlet side of the collector array by:

	on a tile roof with a flat tile profile	other roof cladding type
one solar collector	15 – 20 mm	10 – 15 mm
two solar collectors	30 – 40 mm	20 – 30 mm
three solar collectors	45 – 60 mm	30 – 45 mm

If in doubt use a spirit level.

- The solar hot outlet is higher than the hot sensor housing.
- Maximum recommended total combined solar hot and solar cold pipe length is not exceeded.
- Solar hot and solar cold pipes are insulated in accordance with the installation instructions.
- The end of the connectors are orientated downward, below the collector connection, to ensure complete drain back of the closed circuit fluid from the solar collectors in a closed circuit system.
- The solar hot and solar cold pipes grade downwards with a continuous fall of a minimum 5° (1 in 10 grade) from the solar collectors to the storage tank for a closed circuit system. If in doubt use a spirit level.
- Maximum height from the base of the storage tank to the top of the solar collectors is not exceeded.



CONNECTION DETAILS

HOOKING COLLECTOR STRAP TO COLLECTOR RAIL

Refer to [installation diagrams](#) on pages 40 to 42 for position and [Detail A](#) on page 30 and [Detail B](#) on page 30.

- Determine which slots in the collector rail(s) (1) will be used for the collector straps (2) after locating the rafters and taking note of the rafter spacing.
- Note:** The collector straps are to be fitted to the collector rail(s) before fixing the straps to the rafters.

Rafter spacing	Recommended slots	
	One collector rail	Two collector rail
300 mm (12")	1 & 4 or 2 & 3	1 & 6 or 2 & 5
400 mm (16")	1 & 3 or 2 & 4	1 & 5 or 2 & 6
450 mm (18")	1 & 4	2 & 5
500 mm (20")	1 & 4	1 & 6 or 2 & 5
600 mm (24")	2 & 3	1 & 5 or 2 & 6
900 mm (36")	1 & 4	2 & 5




Rafter spacing	Recommended slots – Three collectors
	(1 x two and 1 x 3 rd collector rails)
300 mm (12")	1 & 6 (long) & 10 (short) or 2 & 5 (long) & 9 (short)
400 mm (16")	1 & 5 (long) & 10 (short)
450 mm (18")	2 & 5 (long) & 9 (short)
500 mm (20")	1 & 4 (long) & 10 (short)
600 mm (24")	1 & 5 (long) & 10 (short) or 2 & 6 (long) & 9 (short)
900 mm (36")	2 & 5 (long) & 9 (short)

3. Noting the orientation of the collector strap's folded end:


Bottom collector rail – slide the **long** straight end of the collector strap (2) through the appropriate slot from the **underside** of the collector rail (1) (refer to **Detail A**).

Top collector rail – slide the **short** straight end of the collector strap (2) through the appropriate slot from the **underside** of the collector rail (1) (refer to **Detail B**).

Pull the collector strap through until the first bend in the strap slips into the slot in the collector rail. The strap will engage with the collector rail.

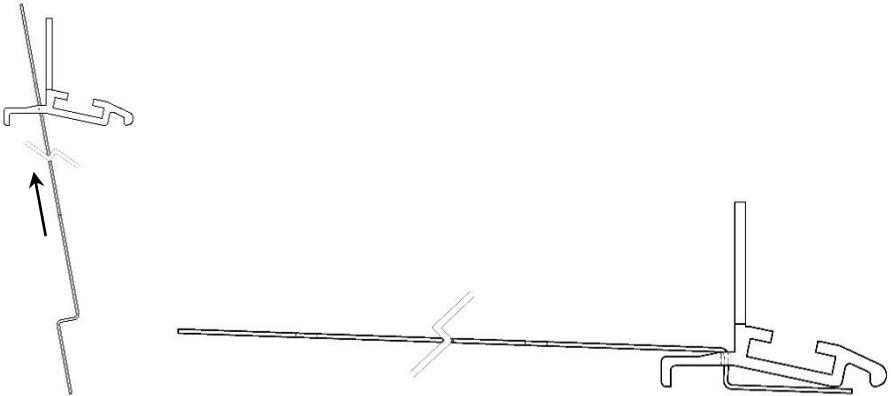

DETAIL A
BOTTOM COLLECTOR RAIL – COLLECTOR STRAP ORIENTATION

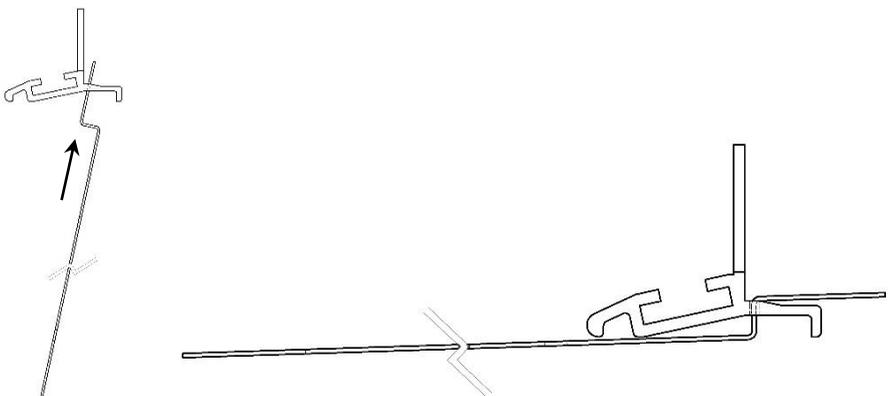


DETAIL B
TOP COLLECTOR RAIL – COLLECTOR STRAP ORIENTATION

COUPLING COLLECTOR TO COLLECTOR – CONETITE FITTING

Refer to [installation diagrams on pages 41 and 42](#) for position and [Detail C](#).


1. Fit a collector union (3) to each collector connection of the first solar collector (17) to receive the second solar collector and screw in the unions until they seat firmly against the collector connection. Hand tighten only so the solar collectors can be shifted and centred.
2. Place the collector unions (3) into the collector connections on the second solar collector and screw in the unions until they seat firmly against the collector connection. Hand tighten only so the solar collectors can be shifted and centred.
3. Repeat steps 1 and 2 for a third solar collector (if installed).
4. After the solar collectors are centred on the collector rail(s), tighten each collector union (3) with a spanner applying medium pressure.

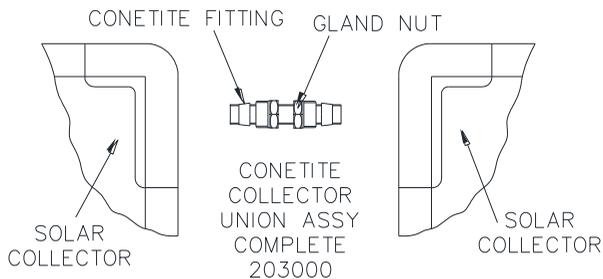**DETAIL C – COLLECTOR UNION ASSEMBLY – CONETITE FITTING**

CLAMPING COLLECTOR TO COLLECTOR RAIL

Refer to **installation diagrams** on pages 40 to 42 for position and **Detail D** on page 32 and **Detail E** on page 33.


1. Insert the head of a Tee bolt (13) into the Tee groove of the collector rail and slide along until it lines up with a checkout in the collector rail. Two Tee bolts (13) are to be used at each end of each collector. Tee bolts (13) are to be fitted in all locations where there is a checkout in the collector rail.
2. Fit a collector clamp onto each Tee bolt (13), ensuring each collector clamp is fully inserted into the collector fixing groove. The collector clamp will fit through the checkout on the collector rail.
3. Fit a washer over the Tee bolt and screw a nut onto each Tee bolt (13). Hand tighten only so the solar collectors can be shifted and centred.
4. After the solar collectors are centred on the collector rail (1) and the collector unions (13) have been tightened, tighten each nut.

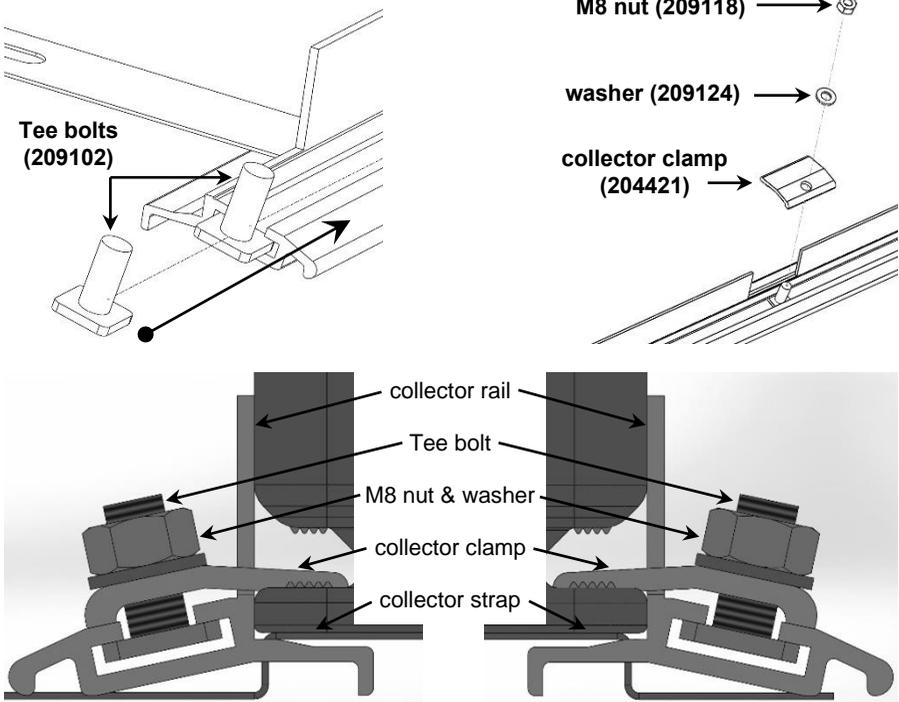


top collector rail

bottom collector rail

DETAIL D – CLAMPING COLLECTOR TO COLLECTOR RAIL

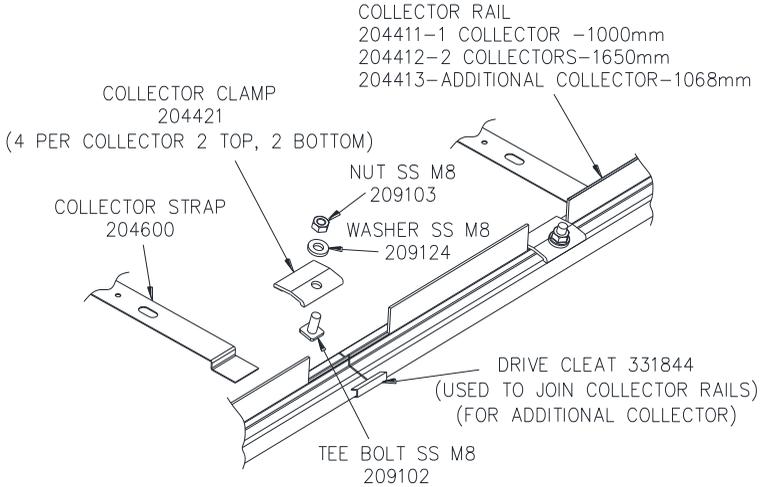

Bottom Collector Rail

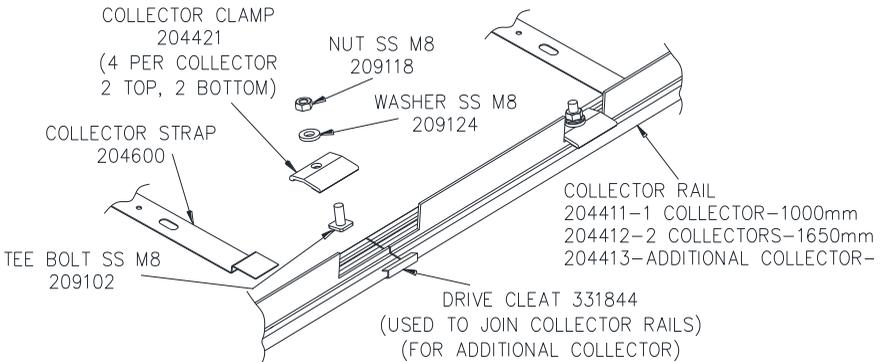


Top Collector Rail

DETAIL E – CLAMPING COLLECTOR TO COLLECTOR RAIL

HOT SENSOR HOUSING ASSEMBLY – CONETITE FITTING

Refer to [installation diagram](#) on page 41 for position and [Detail F](#).

1. Place the sensor housing (4) into the collector connection and screw in the gland nut until it seats firmly against the collector connection, applying medium pressure with a spanner to tighten.
2. Insert the sensor of the hot sensor lead assembly (9) into the sensor housing (4), ensuring the sensor is pushed all the way up to the end of the sensor housing (4).
3. Lock it into position with the locking washer and clip provided.

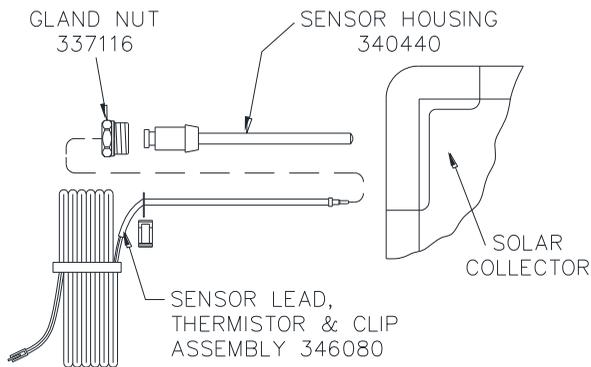


DETAIL F – HOT SENSOR HOUSING ASSEMBLY – CONETITE FITTING

END PLUG ASSEMBLY – CONETITE FITTING

Refer to [installation diagram](#) on page 41 for position and [Detail G](#).

1. Place the end plug (5) into the collector connection and screw in until it seats firmly against the collector connection, applying medium pressure with a spanner to tighten.

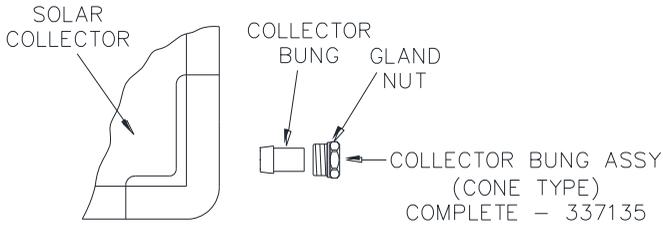
**DETAIL G – END PLUG ASSEMBLY – CONETITE FITTING****COUPLING COLD AND HOT PIPES TO COLLECTOR – CONETITE FITTING**

Refer to [installation diagram](#) on page 41 for position and [Detail H](#) and [Detail J](#) on page 36.


1. Place the connector (10) into the collector connection and screw in the union until it seats firmly against the collector connection, applying medium pressure with a spanner to tighten.

Note: The end of the connectors must be orientated downward, below the collector connection, to ensure complete drain back of the closed circuit fluid from the solar collectors in a closed circuit system.

2. Place the compression nut (11) and olive (12) over the end of the solar cold pipe. Position the cold pipe into the connector fitting (10), seat the olive (12) and tighten the compression nut (11).
3. Repeat this procedure with the connector (10) to couple the solar hot pipe to the solar collector (17).

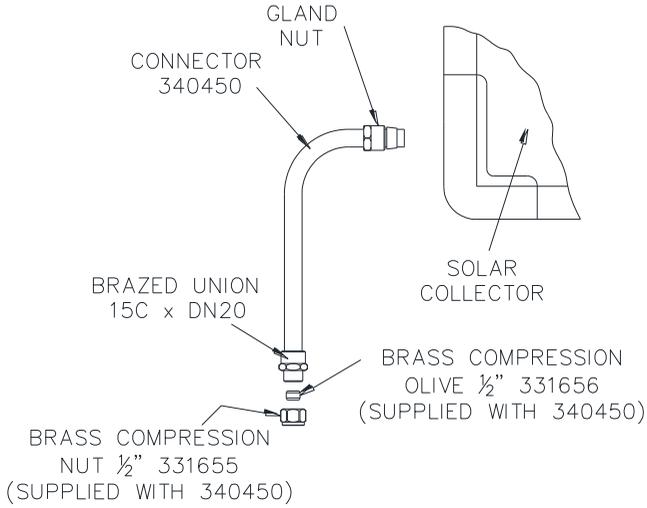



**DETAIL H – CONNECTOR ASSEMBLY – CONETITE FITTING
(SOLAR COLD CONNECTION TO SOLAR COLLECTOR)**

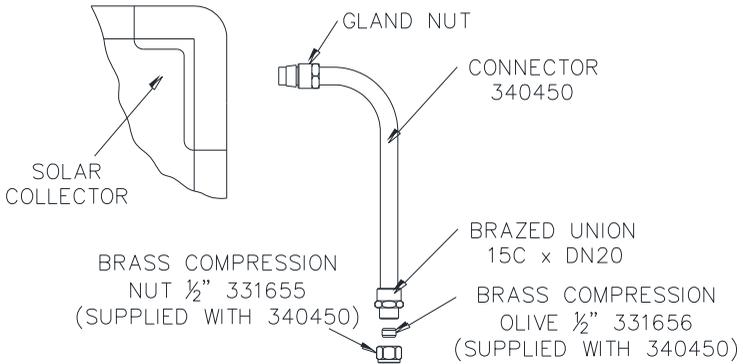

**DETAIL J – CONNECTOR ASSEMBLY – CONETITE FITTING
(SOLAR HOT CONNECTION TO SOLAR COLLECTOR)**

PIPE WORK ROUGHING IN DIMENSIONS

Refer to the diagrams for roughing in dimensions for pipe work to the solar collectors and to the solar storage tank.

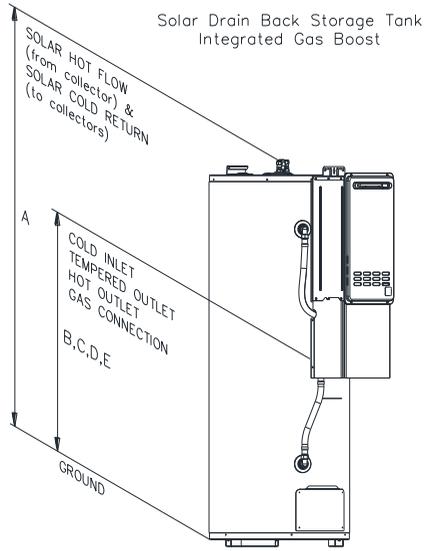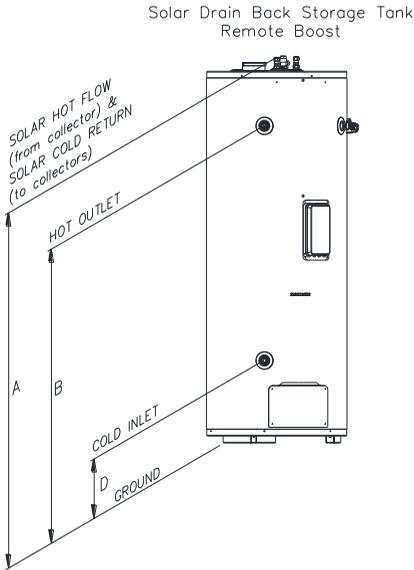


Electric, Remote Boost and Integrated Gas Boost Solar Storage Tanks 270 Litre (Closed Circuit System)


Pipe Work to Solar Storage Tank	A	B	C	D	E
	Solar Hot & Cold *	Hot Outlet	Tempered Outlet	Cold Inlet	Gas
270 tank – electric boost, storage	1775	1453	-	378	-
270 tank – integrated gas boost	1775	819	819	819	819

Note: * Allow at least an additional 200 mm above the solar hot flow and solar cold return fitting dimensions for roughing in pipe terminations.

Solar Drain Back Storage Tank
Remote Boost

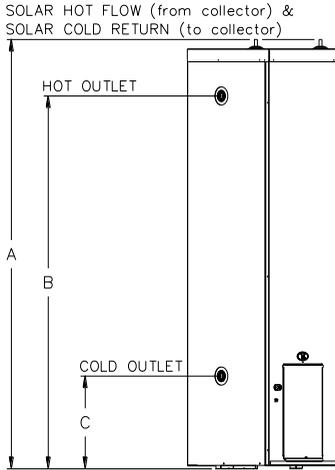


Solar Drain Back Storage Tank
Integrated Gas Boost

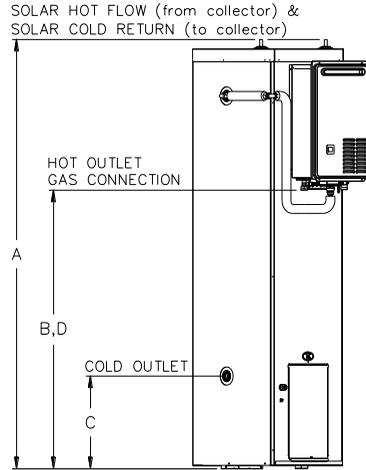

**Remote Gas Boost and Integrated Boost
Solar Storage Tanks 160 Litre (Closed Circuit System)**

Pipe Work to Solar Storage Tank	A	B	C	D
	Solar Hot & Cold *	Hot Outlet	Cold Inlet	Gas
160 tank – remote gas boost	1958	1615	402	-
160 tank – integrated gas boost	1958	1206	402	1206

Note: * Allow at least an additional 200 mm above the solar hot flow and solar cold return fitting dimensions for roughing in pipe terminations.

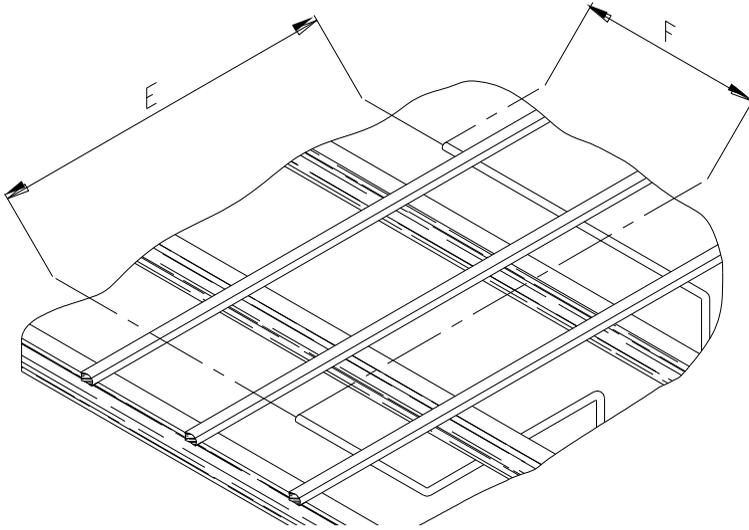


Solar Pipe Work Roughing In Dimensions

Pipe Work to Solar Collectors	E	F
1 Collector	1200	1875
2 Collectors	2260	1875
3 Collectors	3320	1875

EXPLODED VIEWS – SOLAR COLLECTORS

Note: Although the drawings illustrate the solar cold pipe connecting the bottom left hand corner of the solar collector array, the solar cold pipe may be connected to either the bottom right or the bottom left hand corner. The solar hot pipe must connect to the top of the solar collector array diagonally opposite to the solar cold pipe connection.


INSTALLATION ONE COLLECTOR WITH CONETITE FITTINGS

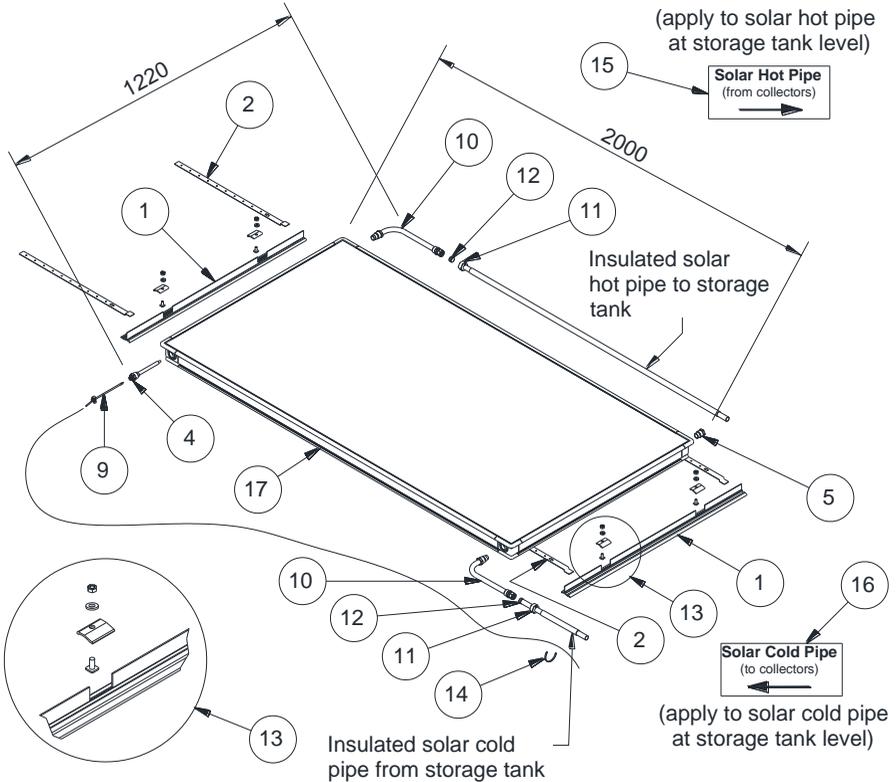

SUPPLIED IN ONE COLLECTOR KIT (CONETITE FITTINGS) (12103011)

- | | |
|-----------------------------|--|
| 1. Collector rail | 13. Tee bolt, collector clamp, washer, nut |
| 2. Collector strap | 14. Cable tie |
| 3. Sensor housing | 15. Label – solar hot pipe |
| 4. End plug | 16. Label – solar cold pipe |
| 9. Hot sensor lead assembly | |
| 10. Connector | (Supplied separately) |
| 11. Compression nut | 17. Solar collector |
| 12. Compression olive | |


INSTALLATION TWO COLLECTORS WITH CONETITE FITTING

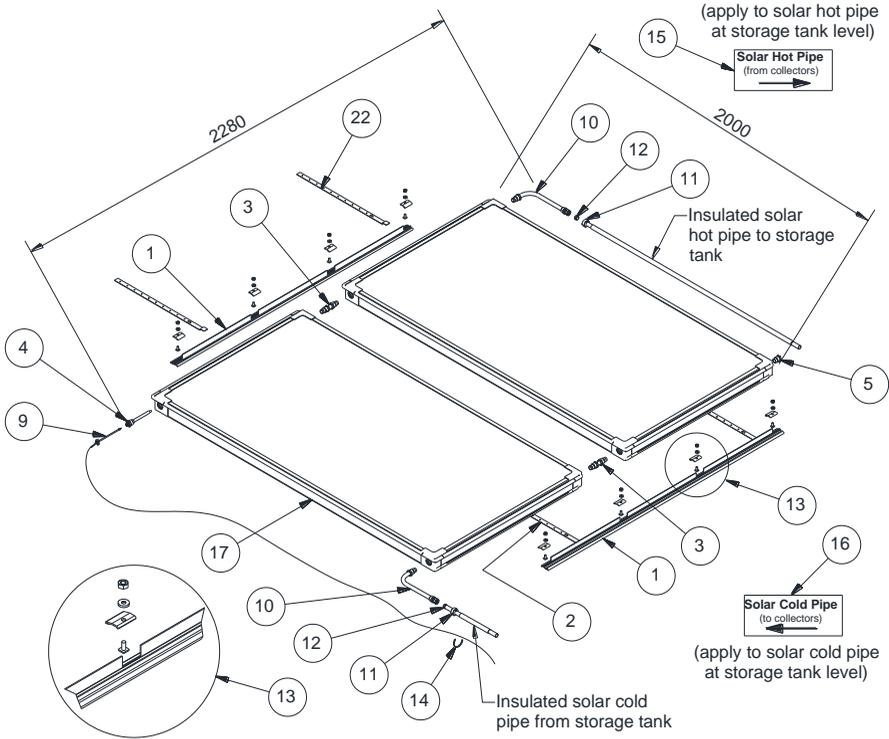

SUPPLIED IN TWO COLLECTOR KIT (CONETITE FITTINGS) (12103012)

- | | |
|-----------------------------|--|
| 1. Collector rail | 13. Tee bolt, collector clamp, washer, nut |
| 2. Collector strap | 14. Cable tie |
| 3. Collector union | 15. Label – solar hot pipe |
| 4. Sensor housing | 16. Label – solar cold pipe |
| 5. End plug | |
| 9. Hot sensor lead assembly | (Supplied separately) |
| 10. Connector | 17. Solar collector |
| 11. Compression nut | |
| 12. Compression olive | |

INSTALLATION – ADDITIONAL SOLAR COLLECTOR – CONETITE FITTING

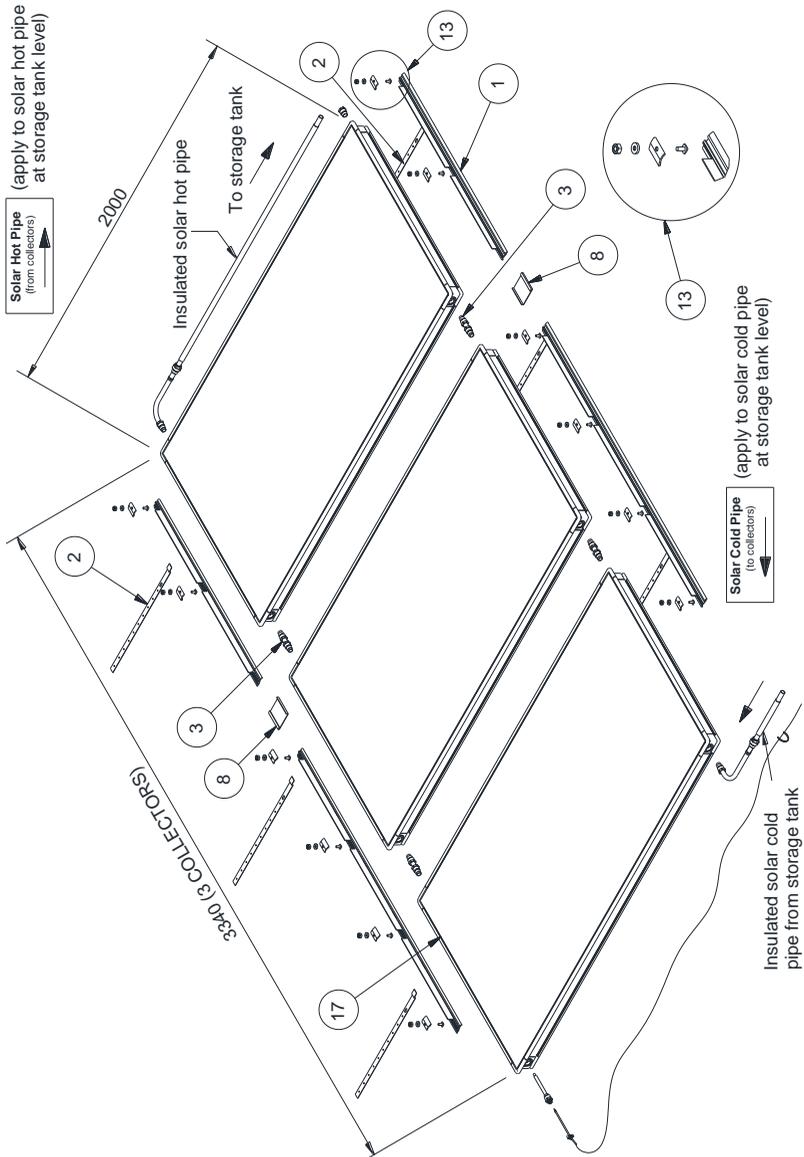

SUPPLIED IN COLLECTOR ADD ON KIT (CONETITE FITTINGS) (12103013)

- | | |
|--------------------|--|
| 1. Collector rail | 13. Tee bolt, collector clamp, washer, nut |
| 2. Collector strap | |
| 3. Collector union | (Supplied separately) |
| 8. Drive cleat | 17. Solar collector |

WARRANTY NOTE

The solar water heater and its components are covered by a manufacturer's warranty. For full details, refer to the Owners Guide and Installation Instructions supplied with the solar storage tank.

The part extracts from the "Terms Of The Warranty And The Exclusions To It" of the water heater Warranty should be noted before commencing the installation of the solar collectors.

TERMS OF THE WARRANTY AND EXCLUSIONS TO IT

- 2.5 Where the water heater is installed in a position that does not allow safe or ready access, the cost of that access, including the cost of additional materials handling and/or safety equipment, shall be the owner's responsibility. In other words, the cost of dismantling or removing cupboards, doors or walls and the cost of any special equipment to bring the water heater to floor or ground level or to a serviceable position is not covered by this warranty.
- 2.7 The warranty does not cover faults that are a result of:
- c) Installation not in accordance with the Owner's Guide and Installation Instructions or with relevant statutory and local requirements in the State or Territory in which the water heater is installed.
 - d) Connection at any time to a water supply that does not comply with the water supply guidelines as outlined in the Owner's Guide and Installation Instructions.
 - k) Breakage of collector glass for any reason including hail damage (we suggest that the collector glass be covered by the home insurance policy).
 - l) Ice formation in the closed circuit system due to non-approved or incorrectly mixed closed circuit fluid being used.
 - m) Non approved or incorrectly mixed closed circuit fluid being used or incorrect or insufficient filling of the closed circuit system with the closed circuit fluid.
- 2.8 Subject to any statutory provisions to the contrary, this warranty excludes any and all claims for damage to furniture, carpet, walls, foundations or any other consequential loss either directly or indirectly due to leakage from the water heater, or due to leakage from fittings and/or pipe work of metal, plastic or other materials caused by water temperature, workmanship or other modes of failure.

Revision Date: 2016 August

207511B

RHEEM AUSTRALIA PTY LTD - ABN 21 098 823 511
1 Alan Street Rydalmere NSW 2116 Australia
(PO Box 7508 Silverwater NSW 2128 Australia)

PATENTS

This water heater may be protected by one or more patents or registered designs in the name of Rheem Australia Pty Ltd.

TRADEMARKS

® Registered trademark of Rheem Australia Pty Ltd.
™ Trademark of Rheem Australia Pty Ltd.

Note: Every care has been taken to ensure the accuracy in preparation of this publication. No liability can be accepted for any consequences, which may arise as a result of its application.