

RIVERBANK ACOUSTICAL LABORATORIES

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

Test Report

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Avalon International Aluminum, LLC
2021-11-29

RAL™-TL21-348

Page 5 of 10

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequency bands. A graphic presentation of the data and additional information appear on the following pages. The precision of the transmission loss test data is within the limits set by the ASTM Standard E90-09 (2016). See Appendix A for identification of corrections applied to the reported data.

<u>FREQ.</u>	<u>TL</u>	<u>ΔTL</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>TL</u>	<u>ΔTL</u>	<u>DEF.</u>
100	37	0.70	0	800	53	0.19	2
125	43	0.61	0	1000	55	0.21	1
160	36	0.66	4	1250	55	0.19	2
200	40	0.53	3	1600	56	0.16	1
250	45	0.33	1	2000	59	0.15	0
315	45	0.32	4	2500	62	0.13	0
400	46	0.18	6	3150	63	0.16	0
500	49	0.17	4	4000	65	0.18	0
630	52	0.23	2	5000	66	0.19	0

STC=53

ABBREVIATION INDEX

FREQ. = 1/3 OCTAVE BAND CENTER FREQUENCY, Hz

TL = TRANSMISSION LOSS, dB

ΔTL = 95% CONFIDENCE INTERVAL FOR TL MEASUREMENTS, dB

DEF. = DEFICIENCIES, dB BELOW SHIFTED STC CONTOUR (SUM OF DEF = 30)

STC = SOUND TRANSMISSION CLASS

Tested by

Marc Sciaky

Senior Experimentalist

Report by

Keith Kimberling

Associate Test Engineer

Approved by

Eric P. Wolfram

Laboratory Manager

Digitally signed
by Eric P Wolfram
Date: 2021.12.14
13:54:12 -06'00'



NVLAP LAB CODE 100227-0

® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

RIVERBANK ACOUSTICAL LABORATORIES

1512 S BATAVIA AVENUE
GENEVA, IL 60134

630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

Test Report

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Avalon International Aluminum, LLC


2021-11-29

RAL™-TL21-348

Page 6 of 10

SOUND TRANSMISSION REPORT

Tacitus Window System

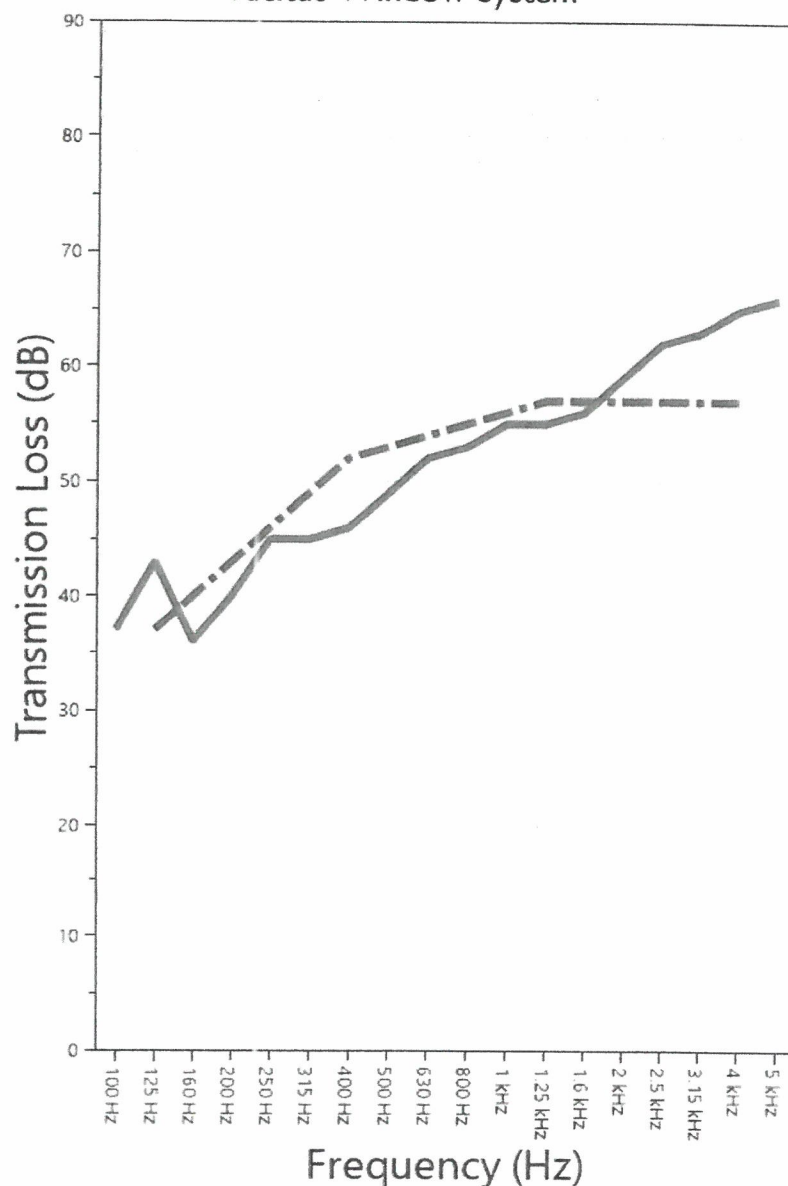

STC=53

OITC=46

TRANSMISSION LOSS

SOUND TRANSMISSION CLASS CONTOUR



NVLAP LAB CODE 100227-0

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

RIVERBANK ACOUSTICAL LABORATORIES

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

Test Report

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Avalon International Aluminum, LLC
2021-11-29

RAL™-TL21-348
Page 7 of 10

APPENDIX A: Extended Frequency Range Data

Specimen: Tacitus Window System (See Full Report)

The following non-accredited data were obtained in accordance with ASTM E90-09 (2016), but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes. Sampling precision observed during this procedure is reported below. Corrections are detailed in Appendix B.

1/3 Octave Band Center Frequency (Hz)	Sound Transmission Loss (dB)	Applicable Corrections	Δ TL (Eq. A2.5) (dB)	Repeatability (dB)
31.5	18	<i>F</i>	0.85	1.24
40	16		1.31	1.44
50	20		1.12	0.98
63	26		1.01	2.33
80	34	<i>F</i>	0.56	1.46
100	37		0.70	0.77
125	43	<i>F</i>	0.61	1.28
160	36		0.66	1.18
200	40		0.53	0.74
250	45		0.33	0.53
315	45		0.32	0.46
400	46		0.18	0.41
500	49		0.17	0.41
630	52		0.23	0.32
800	53		0.19	0.30
1000	55		0.21	0.29
1250	55		0.19	0.15
1600	56		0.16	0.18
2000	59		0.15	0.12
2500	62		0.13	0.28
3150	63		0.16	0.23
4000	65		0.18	0.18
5000	66		0.19	0.26
6300	67	<i>A F</i>	0.18	0.28
8000	63	<i>A F</i>	0.21	0.67
10000	55	<i>AA F</i>	0.27	0.93
12500	43		0.42	1.93