

NOTE: ALL PIPES WITHIN 100 FT BEHIND THE REINFORCED ZONE SHALL BE WATER TIGHT TO PREVENT INFILTRATION OF WATER INTO THE SURROUNDING SOILS.

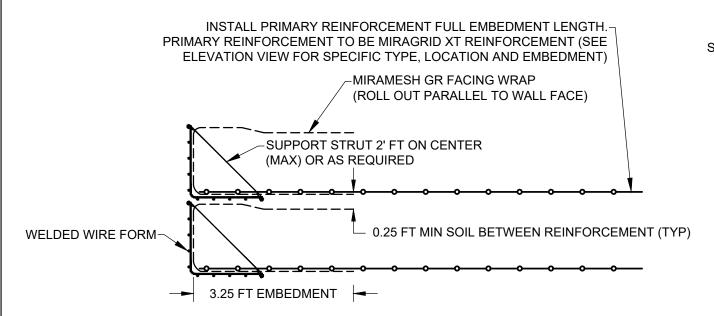

## **FACING DETAIL - PERMANENT WALL (VERTICAL)**

(SCALE: 1" = 2'-0")

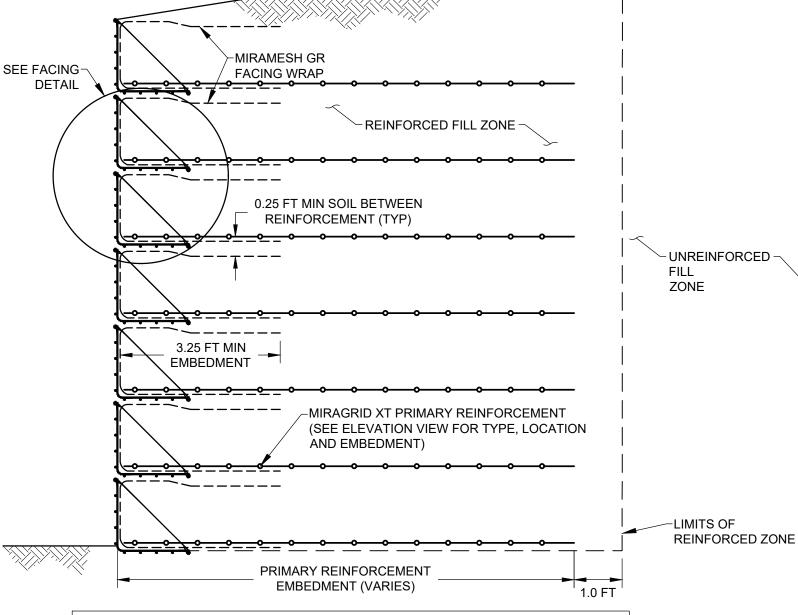

NOTE: FOUNDATION REMEDIATION AS REQUIRED BY ON-SITE GEOTECHNICAL ENGINEER TO OBTAIN STABLE WORKING PLATFORM MEETING THE PARAMETERS IN THE PROJECT SPECIFICATIONS. VERIFICATION OF BEARING CAPACITY MUST BE SUBMITTED BY THE ON-SITE GEOTECHNICAL ENGINEER PRIOR TO CONSTRUCTION.

## TYPICAL WWM MSE WALL (VERTICAL) CROSS SECTION - PERMANENT WALL

(SCALE: 1" = 2'-0")



NOTE: THE STANDARD DETAILS ILLUSTRATED IN THESE DRAWINGS ARE FOR INFORMATION AND EVALUATION PURPOSES ONLY AND ARE NOT FOR CONSTRUCTION. PROJECT SPECIFIC CALCULATIONS, SHOP DRAWINGS AND SPECIFICATIONS, SIGNED AND SEALED BY A REGISTERED LICENSED ENGINEER, ARE REQUIRED FOR CONSTRUCTION.

## WELDED WIRE MESH FORM MSE WALL PERMANENT WWM MSE WALL - VERTICAL

DATE: STANDARD DETAIL NOT FOR CONSTRUCTION SCALE: SHEET OF 12